





Legend

- | | | | | | | | | | |
|--|--------------------------|--|--------------------|--|--------------------------------|--|---------------|--|---------------------|
| | BlowOff | | Meter Vault | | Double, 1,500 or greater GPM | | 16" Mains | | Blowoff Lateral |
| | AirVac | | Water Meter | | Single, 500 - 999 GPM | | 12" Mains | | Air Release Lateral |
| | CHECK VALVE | | Back Flow Device | | Standard, 1,500 or greater GPM | | 10" Mains | | Hydrant Lateral |
| | PRV | | Production Well | | Standard, 1,000 - 1,499 GPM | | 8" Mains | | Service Lateral |
| | PSV | | End Line Flow | | Standard, 500 - 999 GPM | | 6" Mains | | Boosted Zone |
| | Nitrate Monitoring Wells | | Fire Hydrant Valve | | Water Tank | | 2" & 4" Mains | | Water Grid |
| | Sample Station Points | | Main Valve | | | | | | Parcel Basemap |




LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM



LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET B6

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
B6-1	6		10/8/2011	WHS/RD	19.9	Turns Freely	
B6-2	6		10/8/2011	WHS/RD	19.5	Low Resistance	
B6-3	6		10/8/2011	WHS/RD	19.9	Low Resistance	
B6-4	6		10/6/2011	WHS/RD	19.8	Turns Freely	
B6-5	6		10/6/2011	WHS/RD	19.5	Turns Freely	
B6-6	6		10/6/2011	RD/NP	19.2	Turns Freely	
B6-7	6		10/6/2011	RD/NP	20	Turns Freely	
B6-8	6		10/8/2011	WHS/RD	20	Turns Freely	
B6-9	6		10/8/2011	WHS/RD	20.5	Turns Freely	
B6-10	6		10/6/2011	WHS/RD	18.8	Turns Freely	
B6-11	6		10/6/2011	WHS/RD	20	Turns Freely	
B6-12	6		10/6/2011	WHS/RD	18.5	Turns Freely	
B6-13	6		10/6/2011	WHS/RD	18.5	Turns Freely	
B6-14	6		10/6/2011	WHS/RD	18.7	Turns Freely	
B6-15	6		10/6/2011	WHS/RD	18.5	Turns Freely	
B6-16	6		10/6/2011	WHS/RD	19.5	Turns Freely	
B6-17	6		10/6/2011	WHS/RD	19	Turns Freely	
B6-18	10		10/6/2011	RD/NP	19.4	Turns Freely	
B6-19	10		10/6/2011	RD/NP	20.3	Turns Freely	
B6-20	6		10/8/2011	WHS/RD	19	Turns Freely	
B6-21	6		10/6/2011	WHS/RD	20	Turns Freely	
B6-22	6		10/8/2011	WHS/RD	20	Turns Freely	
B6-23	6		10/8/2011	WHS/RD	20.2	Turns Freely	
B6-24	6		10/8/2011	WHS/RD	0	NOT TURNED	NOT TURNED, HAND WHELL MISSION 2.5" GATE NEED TO REPLACE
B6-25	6		10/8/2011	WHS/RD	20.3	Turns Freely	
B6-26	6		10/6/2011	WHS/RD	19.6	Turns Freely	
B6-27	8		10/6/2011	WHS/RD	19.3	Low Resistance	
B6-28	6		10/6/2011	RD/NP	19	Turns Freely	
B6-29	10		10/6/2011	RD/NP	31	Turns Freely	
B6-30	6		10/6/2011	RD/NP	31	Turns Freely	
B6-31	10		10/6/2011	RD/NP	20.4	Turns Freely	

A6

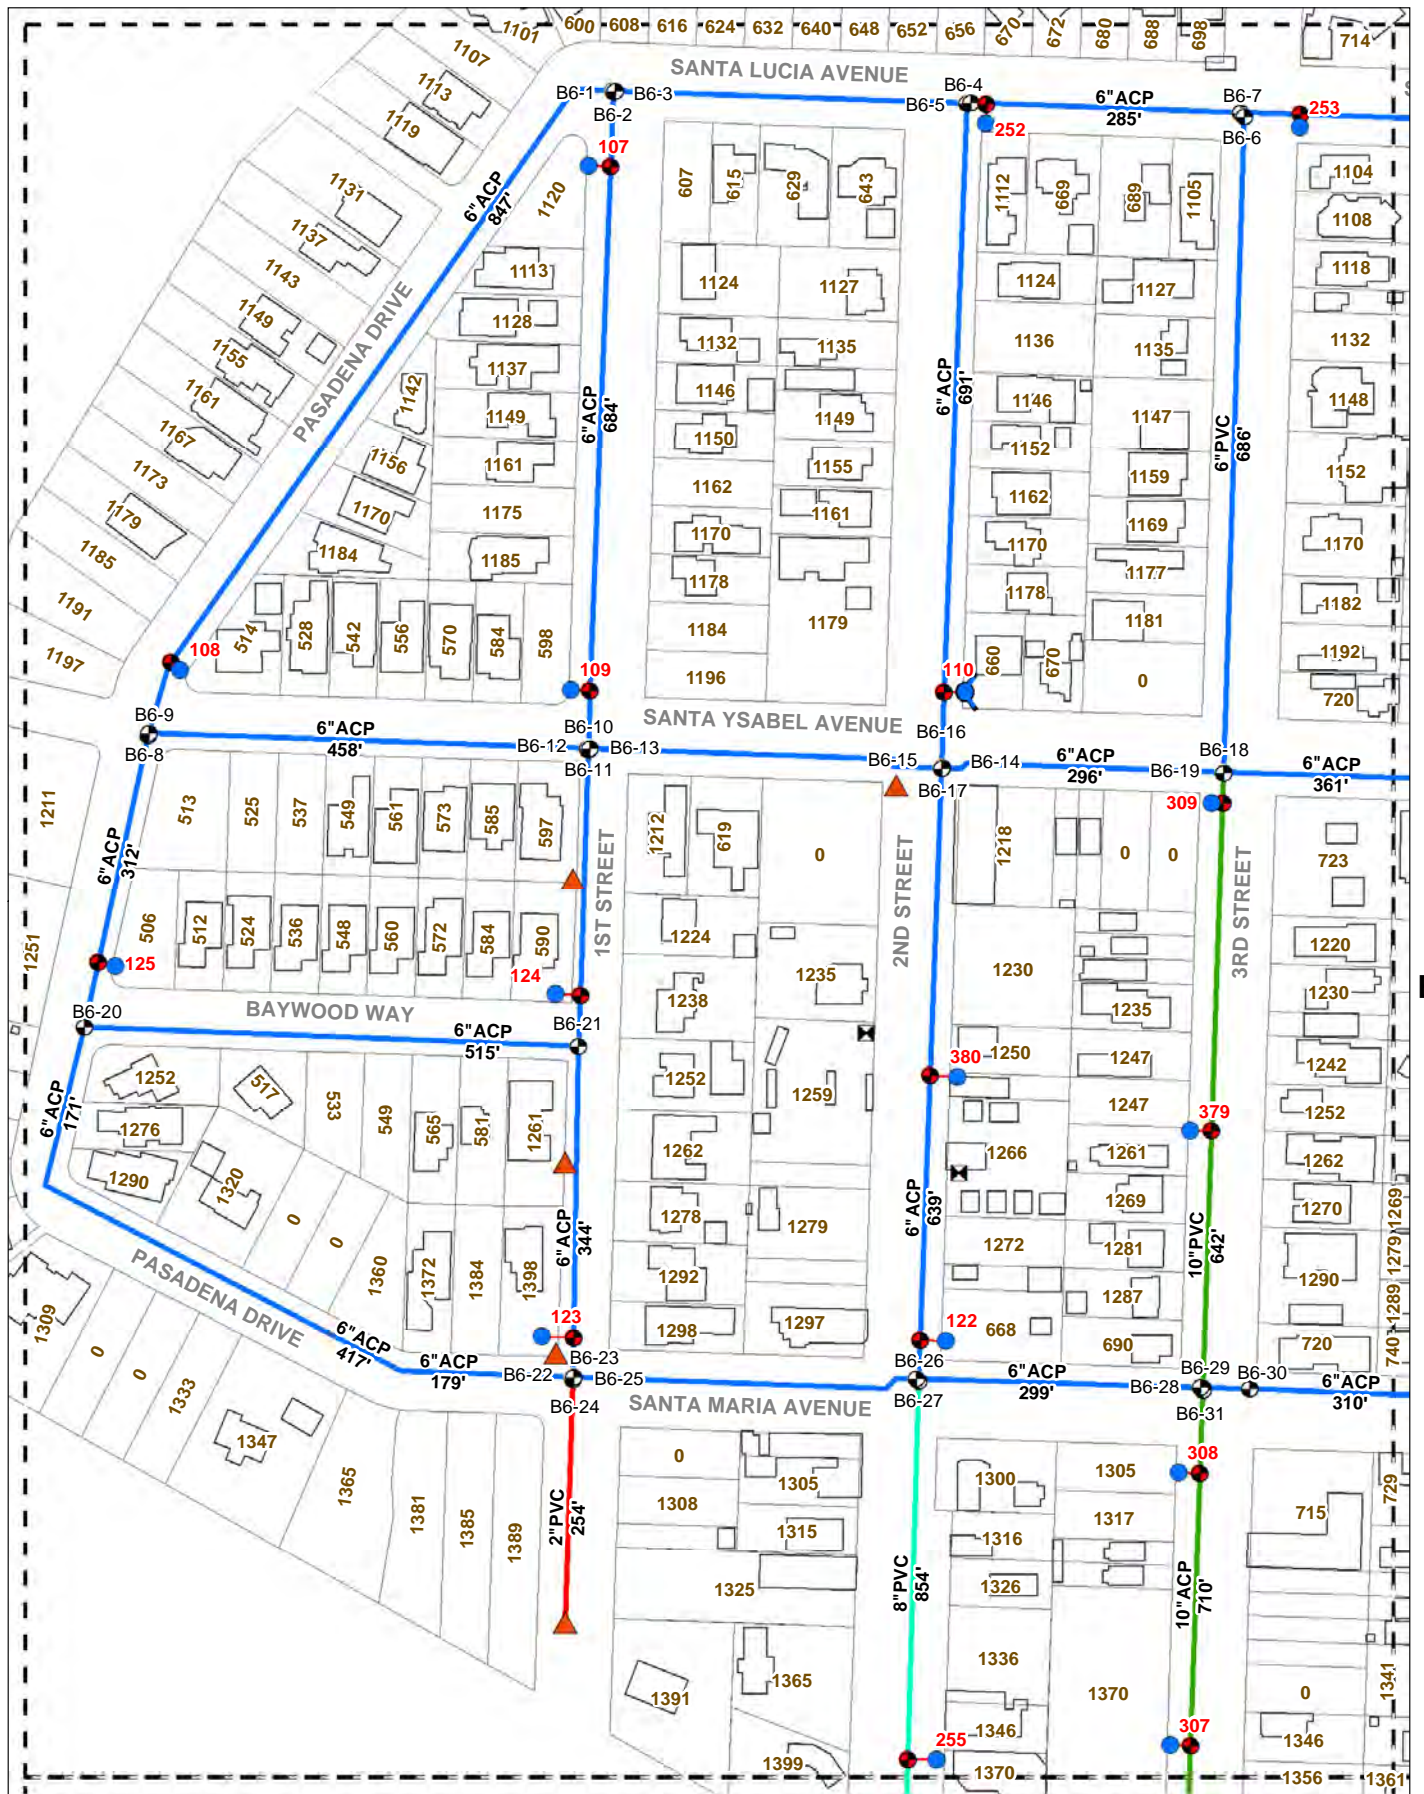

B5

B7



C6

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: B6



1 inch = 200 feet



WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET B7

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
B7-1	6		10/7/2011	RD	20.3	Turns Freely	
B7-2	106		10/7/2011	RD	32	Turns Freely	
B7-3	10		10/7/2011	RD	20.3	Turns Freely	
B7-4	6		10/7/2011	RD	19.3	Turns Freely	
B7-5	6		10/12/2011	RD/NP	19.6	Turns Freely	
B7-6	6		10/12/2011	RD/NP	20.5	Turns Freely	
B7-7	6		10/27/2011	RF/NP	20.7	Low Resistance	
B7-8	10		10/27/2011	RF/NP	32.7	Turns Freely	
B7-9	6		10/27/2011	RF/NP	20.6	Low Resistance	
B7-10	10		10/27/2011	RF/NP	0	Unable to Access	1/25/11 - unable to turn 350 ft lbs - replace
B7-11	10		10/27/2011	WHS/RF	20	Turns Freely	
B7-12	6		10/27/2011	WHS/RF	19.8	Turns Freely	
B7-13	6		10/12/2011	RD/NP	19.6	Low Resistance	
B7-14	6		1/24/2011	RD/RF	19.4	High Resistance	
B7-15	6		10/12/2011	RD/NP	19.5	Low Resistance	
B7-16	6		10/12/2011	RD/NP	20	Turns Freely	
B7-17	6		10/12/2011	RD/NP	20.3	Turns Freely	
B7-18	6		10/12/2011	RD/NP	19.9	Turns Freely	
B7-19	6		10/15/2011	RD/NP	19.7	Low Resistance	
B7-20	6		10/15/2011	RD/NP	20.4	Turns Freely	
B7-21	6		10/17/2011	RF/RD	20	Turns Freely	
B7-22	6		10/17/2011	RF/RD	20	Turns Freely	
B7-23	6		10/17/2011	RF/RD	19.7	Turns Freely	





B6

B8

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: B7



WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET B8


ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
B8-1	6		10/20/2011	WHS/RF	13.8	Turns Freely	
B8-2	10		10/27/2011	WHS/RF	20	Turns Freely	
B8-3	10		10/27/2011	WHS/RF	31.4	Turns Freely	
B8-4	10		10/27/2011	WHS/RF	31.5	Turns Freely	
B8-5	10		10/27/2011	RF	20.9	Turns Freely	
B8-6	6		10/27/2011	RF	19.5	Low Resistance	
B8-7	6		10/27/2011	WHS/RF	20	Turns Freely	
B8-8	6		10/27/2011	WHS/RF	19.7	Turns Freely	
B8-9	10		10/27/2011	WHS/RF	20	Turns Freely	
B8-10	10		10/27/2011	WHS/RF	30.5	Moderately	
B8-11	6		10/27/2011	WHS/RF	20	Turns Freely	
B8-12	6		10/27/2011	WHS/RF	19.6	Turns Freely	
B8-13	10		10/27/2011	WHS/RF	20.3	Turns Freely	
B8-14	6		10/18/2011	RF	19.6	Low Resistance	
B8-15	6		10/19/2011	RF	18.5	Low Resistance	
B8-16	6		10/18/2011	RF	20	Turns Freely	
B8-17	6		10/18/2011	RF	19.9	Low Resistance	
B8-18	6		10/18/2011	RF	20.5	Turns Freely	
B8-19	10		10/19/2011	RF	21.3	Turns Freely	
B8-20	6		10/19/2011	RF	32.4	Turns Freely	
B8-21	12		10/19/2011	RF	33.4	Turns Freely	
B8-22	10		10/20/2011	WHS/RF	33.4	Turns Freely	
B8-23	10		10/20/2011	WHS/RF	0	Unable to Turn	On list to replace 10/20/11
B8-24	6		10/24/2011	RF/NP	36.4	Turns Freely	
B8-25	6		10/24/2011	RF/NP	19.7	Turns Freely	
B8-26	6		10/24/2011	RF/NP	19.5	Turns Freely	
B8-27	6		10/24/2011	RF/NP	19.5	Turns Freely	
B8-28	6		10/24/2011	RF/NP	19.3	Turns Freely	
B8-29	6		10/24/2011	RF/NP	20	Turns Freely	
B8-30	6		10/24/2011	RF/NP	20.4	Turns Freely	



B7

B9

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM




WALLACE GROUP®
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET B9

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
B9-1	6				0		
B9-2	4		10/24/2011	RF/NP	13.75	Turns Freely	
B9-3	6		10/26/2011	WHS/RF	20	Turns Freely	
B9-4	6		10/25/2011	WHS/RF	20.2	Turns Freely	
B9-5	6		6/3/2002	FA/RK	0	Should Replace	Non operational - no valve can
B9-6	10		10/27/2011	WHS/RF	32	Turns Freely	
B9-7	6		10/27/2011	WHS/RF	20.3	Turns Freely	
B9-8	6		10/27/2011	WHS/RF	20.5	Turns Freely	
B9-9	10		10/27/2011	WHS/RF	20	Low Resistance	
B9-10	10		10/27/2011	WHS/RF	32.1	Low Resistance	
B9-11	10		10/27/2011	WHS/RF	20	Low Resistance	
B9-12	12	Mueller	10/27/2011	WHS/RF	38.7	Turns Freely	
B9-13	6		10/27/2011	WHS/RF	20.5	Low Resistance	
B9-14	10		10/27/2011	WHS/RF	32.9	High Resistance	
B9-15	6		10/27/2011	WHS/RF	20.2	Low Resistance	
B9-16	6	Mueller	10/27/2011	WHS/RF	0		
B9-17	10		10/27/2001	WHS/RF	31.5	Low Resistance	
B9-18	10	Mueller	10/26/2011	WHS/RF	33.1	Turns Freely	
B9-19	10		10/27/2001	WHS/RF	32	Low Resistance	
B9-20	6	Mueller	10/27/2011	WHS/RF	20.75	Turns Freely	
B9-21	10		6/1/2002	FA/RK	32	Turns Freely	
B9-22	6		10/25/2011	WHS/RF	20.4	Turns Freely	
B9-23	6		10/25/2011	WHS/RF	20.1	Turns Freely	
B9-24	6		10/25/2011	WHS/RF	19.4	Turns Freely	
B9-25	6		10/25/2011	WHS/RF	18.7	Turns Freely	
B9-26	10	Mueller	10/26/2011	WHS/RF	27	Turns Freely	
B9-27	12	Mueller	10/26/2011	WHS/RF	26.69	Turns Freely	
B9-28	12	Mueller	10/26/2011	WHS/RF	27.1	Turns Freely	
B9-29	10	Mueller	10/26/2011	WHS/RF	27.2	Turns Freely	
B9-30	6	Mueller	10/26/2011	WHS/RF	27.3	Turns Freely	
B9-31	12	Mueller	10/26/2011	WHS/RF	27.2	Turns Freely	
B9-32	12	Mueller	10/26/2011	WHS/RF	27	Turns Freely	
B9-33	6	Mueller	10/26/2011	WHS/RF	27.3	Turns Freely	
B9-34	6		6/1/2002	FA/RK	0	NA	
B9-35	12	Mueller			0		
B9-36	12	Mueller			0		
B9-37	16	Mueller			0		
B9-38	10	Mueller			0		
B9-39	8	Mueller			0		
B9-40	10	Mueller			0		
B9-41	16	Mueller			0		317A = Do not exercise ISO valve for boosted/gravity zone
B9-42	16	Mueller			0		317B = Do not close unless pumps in booster station are off

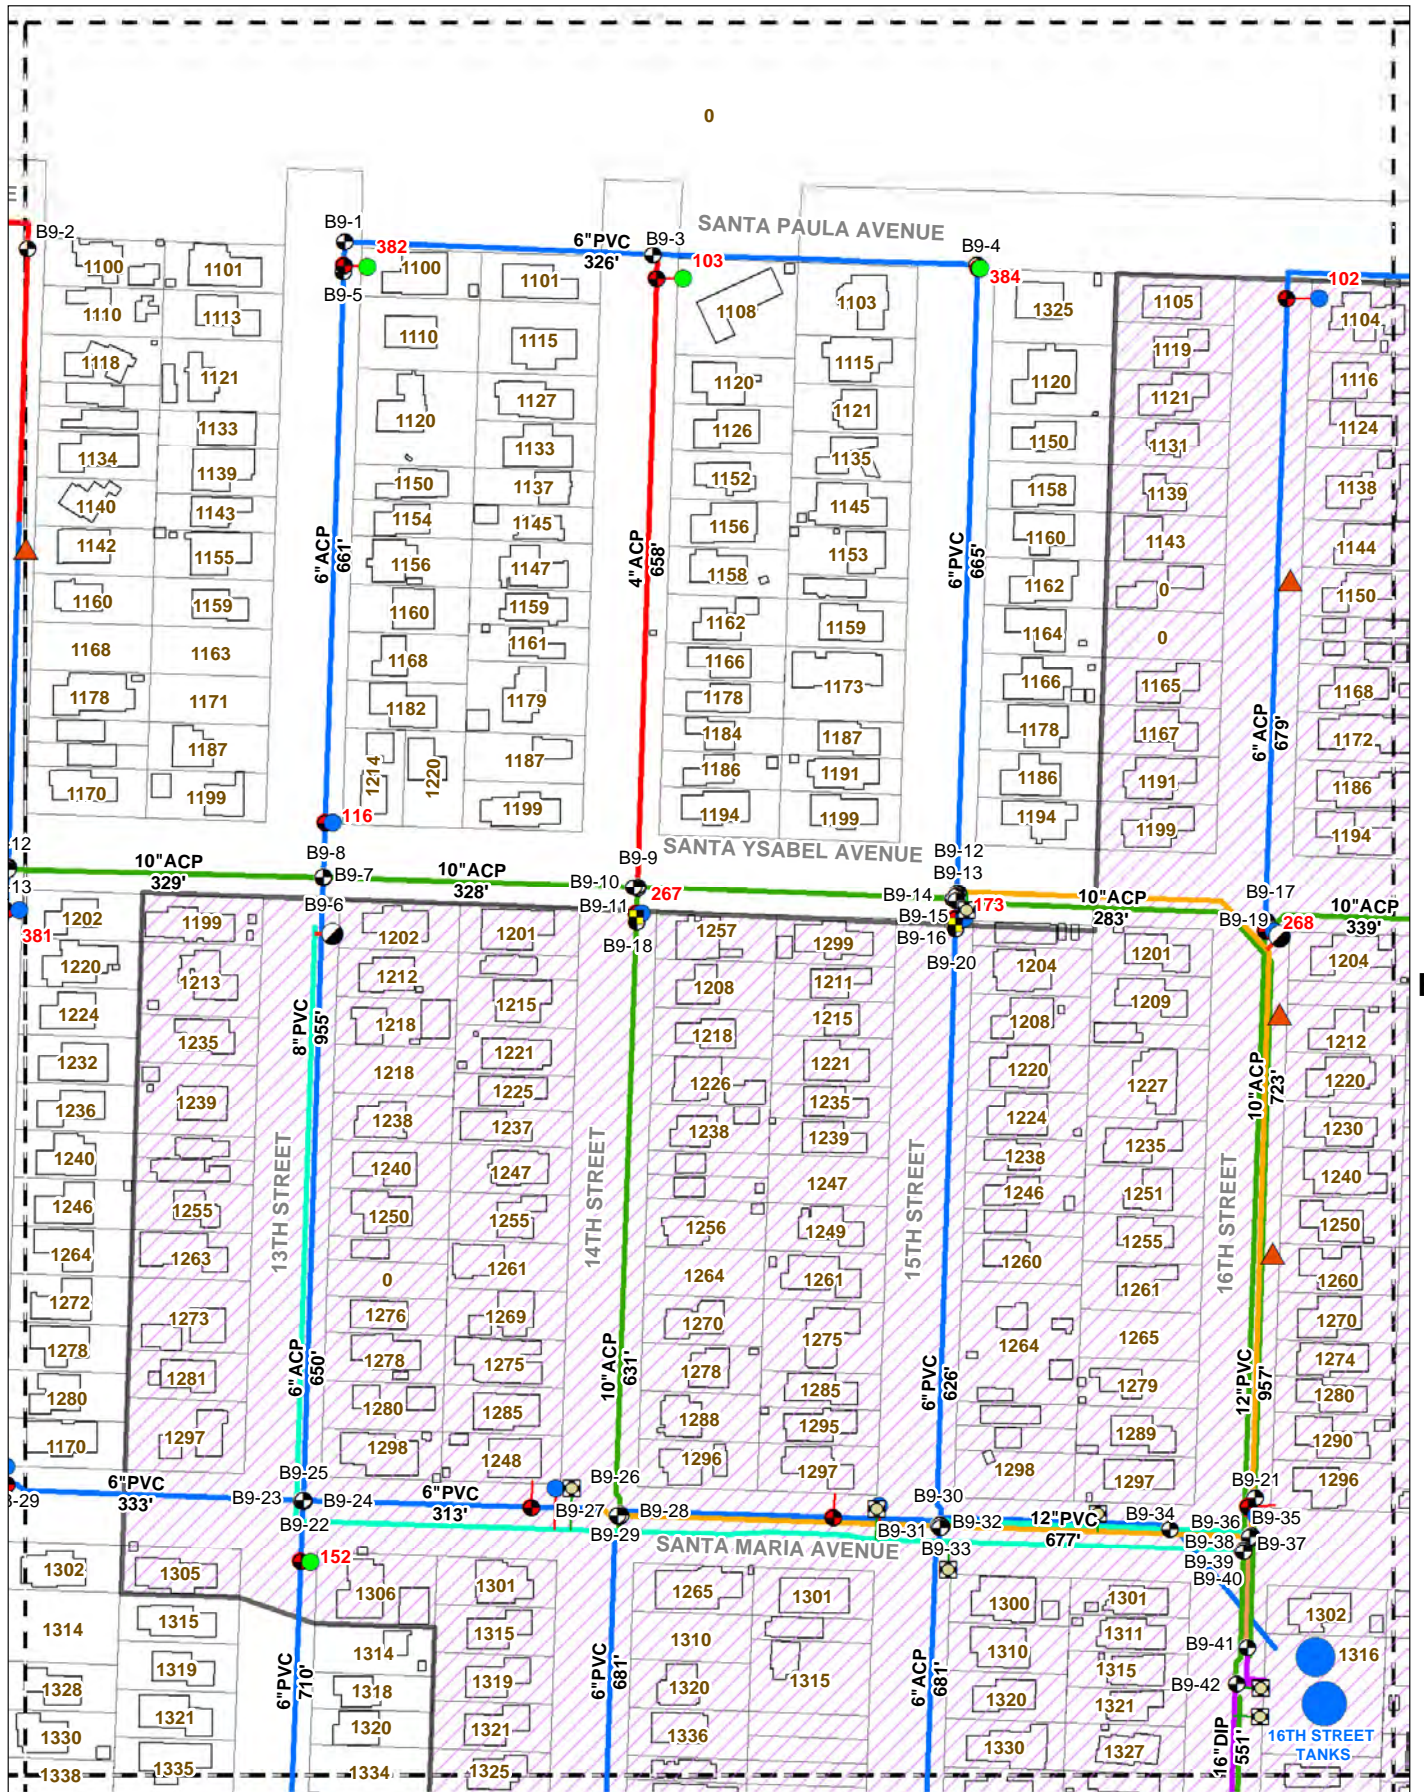


B8

B10

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM


SHEET: B9





B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET B10

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
B10-1	6		10/31/2011	RF/RD	20.2	Turns Freely	
B10-2	10		10/31/2011	RF/RD	32	Moderately	
B10-3	6		10/31/2011	RF/RD	19.2	Low Resistance	
B10-4	6		10/31/2011	RF/RD	18.9	Turns Freely	
B10-5	10		11/1/2011	RD	26	Turns Freely	Church of the Nazarene
B10-6	6		10/31/2011	RF/RD	19	Turns Freely	

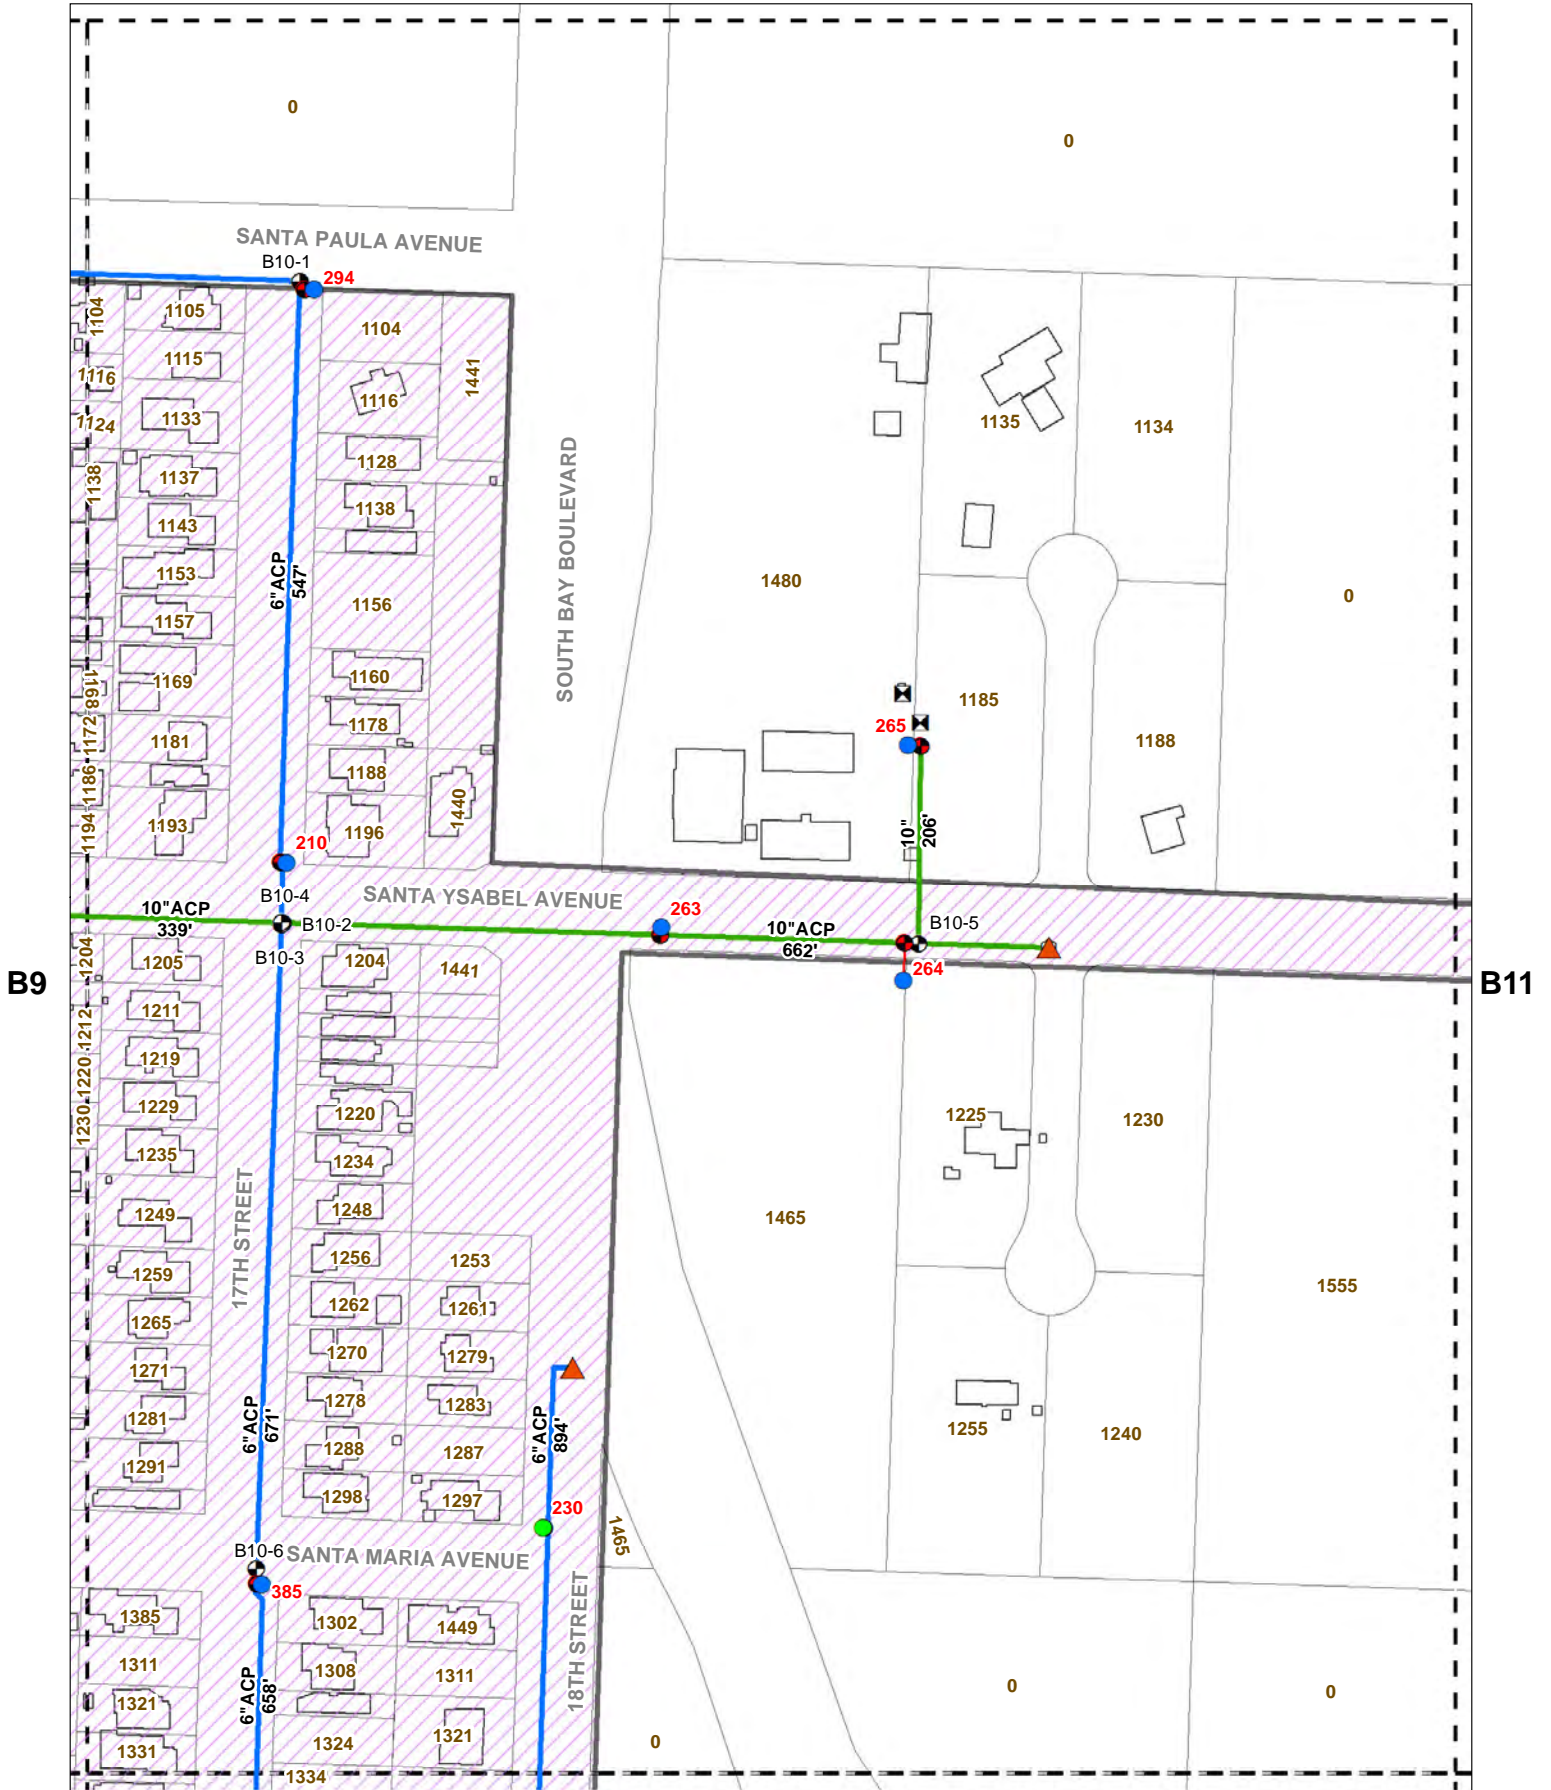

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM




WALLACE GROUP
MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C6

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C6-1	10		10/7/2011	RD/NP	31.5	Turns Freely	
C6-2	8		10/7/2011	RD/NP	25.7	Turns Freely	
C6-3	6		10/7/2011	RD/NP	19.8	Turns Freely	
C6-4	6		10/7/2011	RD	19.2	High Resistance	42 ft lbs
C6-5	6		10/7/2011	RD	19.5	High Resistance	66 ft lbs won't turn all the way on lowest setting 50 ft lbs

B6

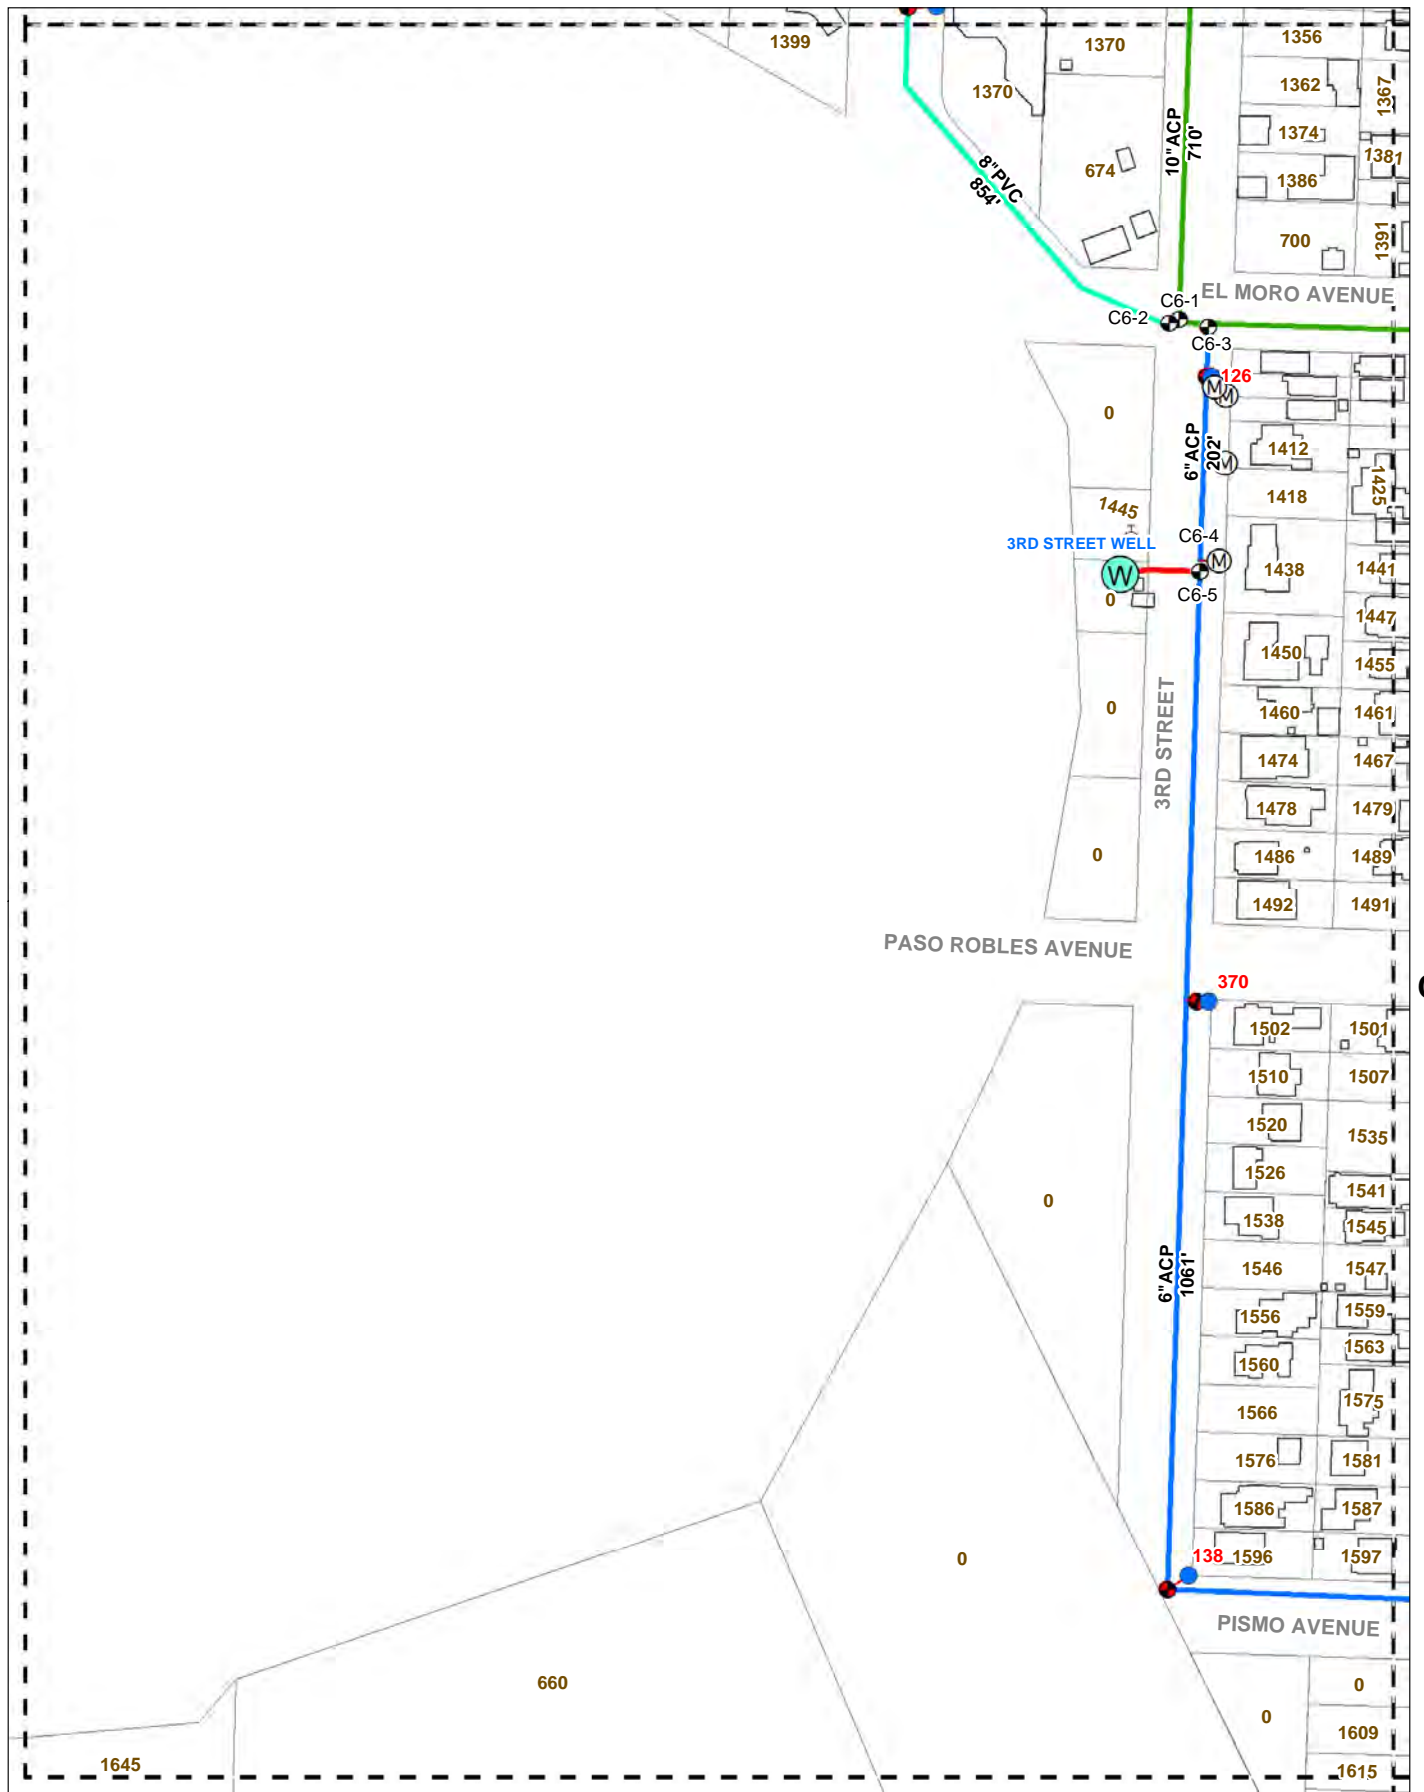



C5

C7


D6

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM

SHEET: C6




WALLACE GROUP
MAP PUBLISHED APRIL 2012



LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C7

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C7-1	6		10/12/2011	RD/NP	20.8	Low Resistance	
C7-2	8		10/12/2011	RD/NP	19.8	Turns Freely	
C7-3	6		10/15/2011	RD/NP	19.6	Turns Freely	
C7-4	6		10/12/2011	RD/NP	19.9	Turns Freely	
C7-5	6		10/15/2011	RD/NP	19.4	Turns Freely	
C7-6	6		10/17/2011	RF	20.5	Turns Freely	
C7-7	6		10/17/2011	RF	20.1	Turns Freely	
C7-8	8		10/12/2011	RD/NP	24.8	Turns Freely	
C7-9	6		10/12/2011	RD/NP	19.6	Turns Freely	
C7-10	8		10/12/2011	RD/NP	25.7	Turns Freely	
C7-11	6		10/15/2011	RD/NP	18.5	Turns Freely	
C7-12	6		10/17/2011	RF	20.2	Turns Freely	
C7-13	6		10/17/2011	RF	19.8	Turns Freely	
C7-14	6		10/15/2011	RD/NP	19.5	Turns Freely	
C7-15	8		10/12/2011	RD/NP	22.8	Sticky at End	
C7-16	8		10/12/2011	RD/NP	28	Low Resistance	
C7-17	8		10/12/2011	RD/NP	24	Low Resistance	
C7-18	6		10/15/2011	RD/NP	19.4	Turns Freely	
C7-19	8		10/12/2011	RD/NP	28.1	Turns Freely	
C7-20	8		10/12/2011	RD/NP	27.3	Turns Freely	
C7-21	6		10/12/2011	RD/NP	19.6	Turns Freely	
C7-22	8		10/15/2011	RD/NP	20	Low Resistance	
C7-23	6		10/17/2011	RF	20.5	Low Resistance	
C7-24	8		10/17/2011	RF	26.9	Turns Freely	
C7-25	6		10/18/2011	RF	20.2	Turns Freely	
C7-26	6		10/17/2011	RF	20.5	Turns Freely	
C7-27	6		10/18/2011	RF	26	Turns Freely	
C7-28	8		10/18/2011	RF	26.1	Sticky	

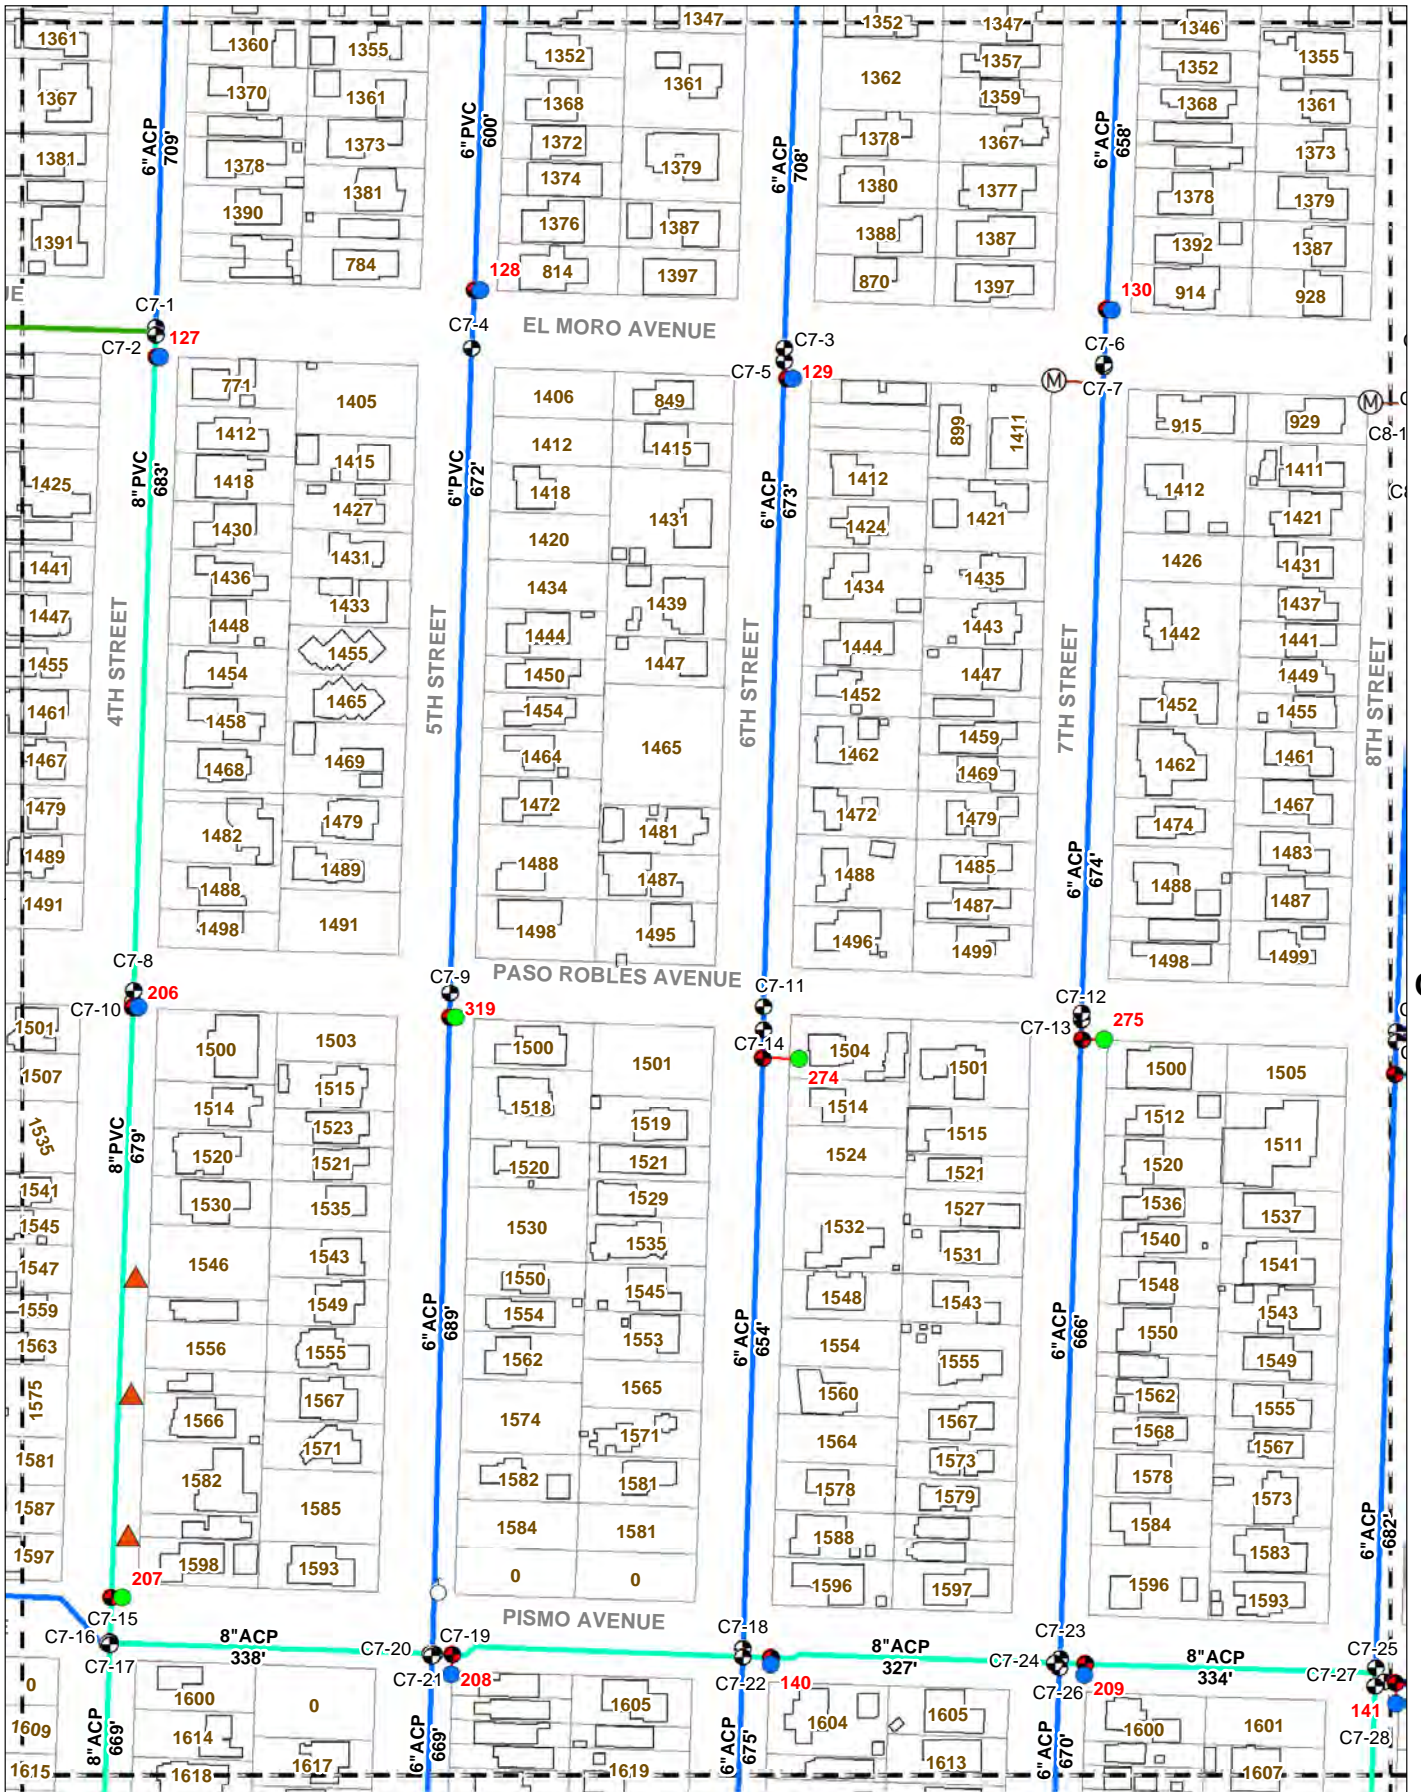

C6



C8

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: C7



1 inch = 200 feet




MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C8

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C8-1	10				0		the valve books
C8-2	10		10/17/2011	RD/RF	32.5	Turns Freely	
C8-3	10		10/17/2011	RD/RF	33.1	Turns Freely	
C8-4	6		10/18/2011	WHS/RF	19.7	Turns Freely	
C8-5	6		10/18/2011	WHS/RF	19.3	Turns Freely	
C8-6	6		10/17/2011	RD/RF	20.1	Turns Freely	
C8-7	6		10/21/2011	RF/NP	21.5	Turns Freely	
C8-8	10		10/19/2011	RF	33	Turns Freely	
C8-9	10		10/21/2011	RF/NP	20.1	Turns Freely	
C8-10	6		10/21/2011	RF/NP	19.4	Turns Freely	
C8-11	6		10/24/2011	RF/NP	19.8	Turns Freely	
C8-12	6		10/24/2011	RF/NP	20.8	Turns Freely	
C8-13	6		10/24/2011	RF/NP	19.3	Turns Freely	
C8-14	0				0		Old Information that have object ID's but doesn't correspond to anything in
C8-15	6				0		
C8-16	10		10/20/2011	WHS/RF	21	Turns Freely	
C8-17	6		10/18/2011	RF	20	Turns Freely	
C8-18	6	Mueller			0		
C8-19	6		10/18/2011	RF	19.2	Turns Freely	
C8-20	6	Mueller	10/24/2011	RF/NP	21.3	Turns Freely	
C8-21	6		10/21/2011	RF/NP	21	Turns Freely	
C8-22	6		10/21/2011	RF/NP	19	Turns Freely	
C8-23	6		10/17/2011	RD/RF	19.6	Turns Freely	
C8-24	6		10/24/2011	RF/NP	0	Turns Freely	
C8-25	6		10/24/2011	RF/NP	19.8	Turns Freely	
C8-26	6		10/21/2011	RF/NP	19.6	Turns Freely	
C8-27	10		10/24/2011	RF/NP	32.2	Turns Freely	
C8-28	10		10/21/2011	RF/NP	32.4	Turns Freely	
C8-29	6		10/18/2011	RF	19.9	Low Resistance	
C8-30	10		10/21/2011	RF/NP	32.1	Turns Freely	
C8-31	6		10/24/2011	RF/NP	19	Turns Freely	
C8-32	6		10/18/2011	RF	19.2	Turns Freely	
C8-33	6		10/18/2011	RF	19.3	Low Resistance	
C8-34	6		10/20/2011	WHS/RF	19.4	Turns Freely	
C8-35	10		10/20/2011	WHS/RF	31	Turns Freely	

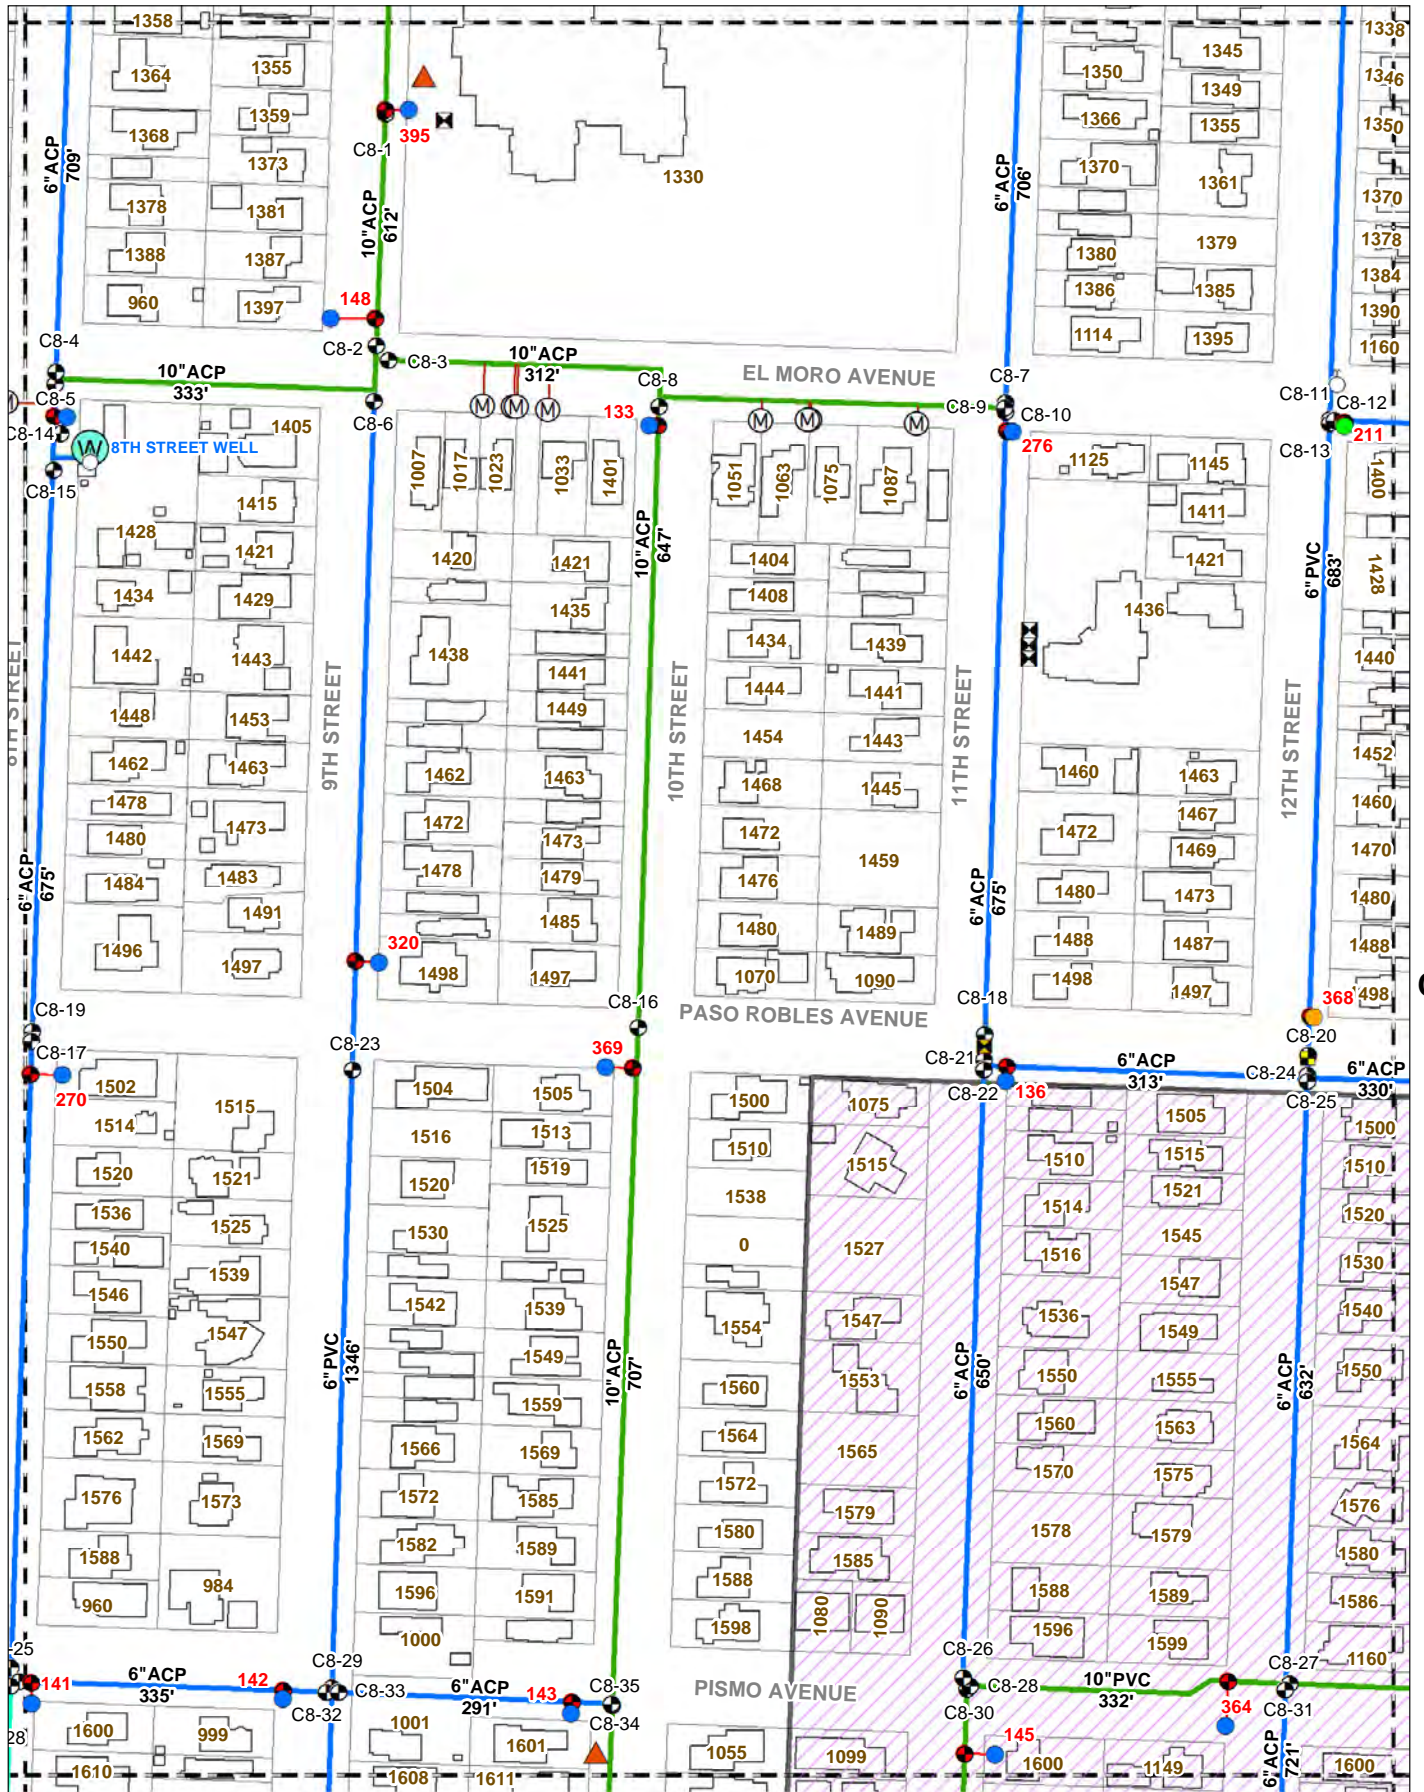

C7



C9

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: C8



1 inch = 200 feet




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C9

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C9-1	6		10/25/2011	WHS/RF	20	Turns Freely	
C9-2	6		10/25/2011	WHS/RF	21	Turns Freely	
C9-3	6		10/25/2011	WHS/RF	19.7	Low Resistance	
C9-4	6	Mueller	10/25/2011	WHS/RF	21.4	Turns Freely	
C9-5	6		10/26/2011	WHS/RF	19.9	Low Resistance	
C9-6	16	Mueller	10/28/2011	RF	31	Moderately	
C9-7	12	Mueller	10/28/2011	RF	38.6	Turns Freely	
C9-8	10	Mueller	10/28/2011	RF	38.5	Turns Freely	
C9-9	6		10/26/2011	WHS/RF	20.4	Turns Freely	
C9-10	6	Mueller	10/31/2011	RF/RD	31	Turns Freely	
C9-11	12	Mueller	10/26/2011	WHS/RF	38.5	Turns Freely	
C9-12	6	Mueller	10/26/2011	WHS/RF	21.1	Turns Freely	
C9-13	6				0		Old Information that have object ID's but doesn't correspond to anything in
C9-14	6		10/25/2011	WHS/RF	20.1	Turns Freely	
C9-15	6		10/25/2011	WHS/RF	19.6	Turns Freely	
C9-16	6		6/1/2002	FA/RK	0	Pending	the valve books
C9-17	6		10/25/2011	WHS/RF	19.7	Turns Freely	
C9-18	6		10/25/2011	WHS/RF	20.1	Turns Freely	
C9-19	6		10/26/2011	WHS/RF	19.4	Turns Freely	
C9-20	6		10/26/2011	WHS/RF	19.6	Turns Freely	
C9-21	6		10/26/2011	WHS/RF	18.6	Low Resistance	
C9-22	6		10/26/2011	WHS/RF	20.1	Low Resistance	
C9-23	6		10/28/2011	RF	20.3	Turns Freely	
C9-24	6		10/28/2011	RF	20.3	Low Resistance	
C9-25	6		10/28/2011	RF	20	Low Resistance	
C9-26	6		10/28/2011	RF	21	Turns Freely	
C9-27	6		10/24/2011	RF/NP	20.6	Turns Freely	
C9-28	6		10/24/2011	RF/NP	19	Turns Freely	
C9-29	10		10/25/2011	WHS/RF	20	Low Resistance	
C9-30	6		10/25/2011	WHS/RF	19.9	Low Resistance	
C9-31	6		10/25/2011	WHS/RF	19.1	Low Resistance	
C9-32	6		10/25/2011	WHS/RF	19	Low Resistance	
C9-33	6		6/1/2002	FA/RK	0	NA	Non operational - valve can in place capped off
C9-34	6		10/26/2011	WHS/RF	19.6	Turns Freely	
C9-35	6		10/26/2011	WHS/RF	19.6	Turns Freely	
C9-36	6		10/26/2011	WHS/RF	19.1	Turns Freely	
C9-37	6		10/27/2011	RF	19.5	Turns Freely	
C9-38	6		10/27/2011	RF	20.1	Turns Freely	
C9-39	10		10/27/2011	RF	30.8	Turns Freely	

B9

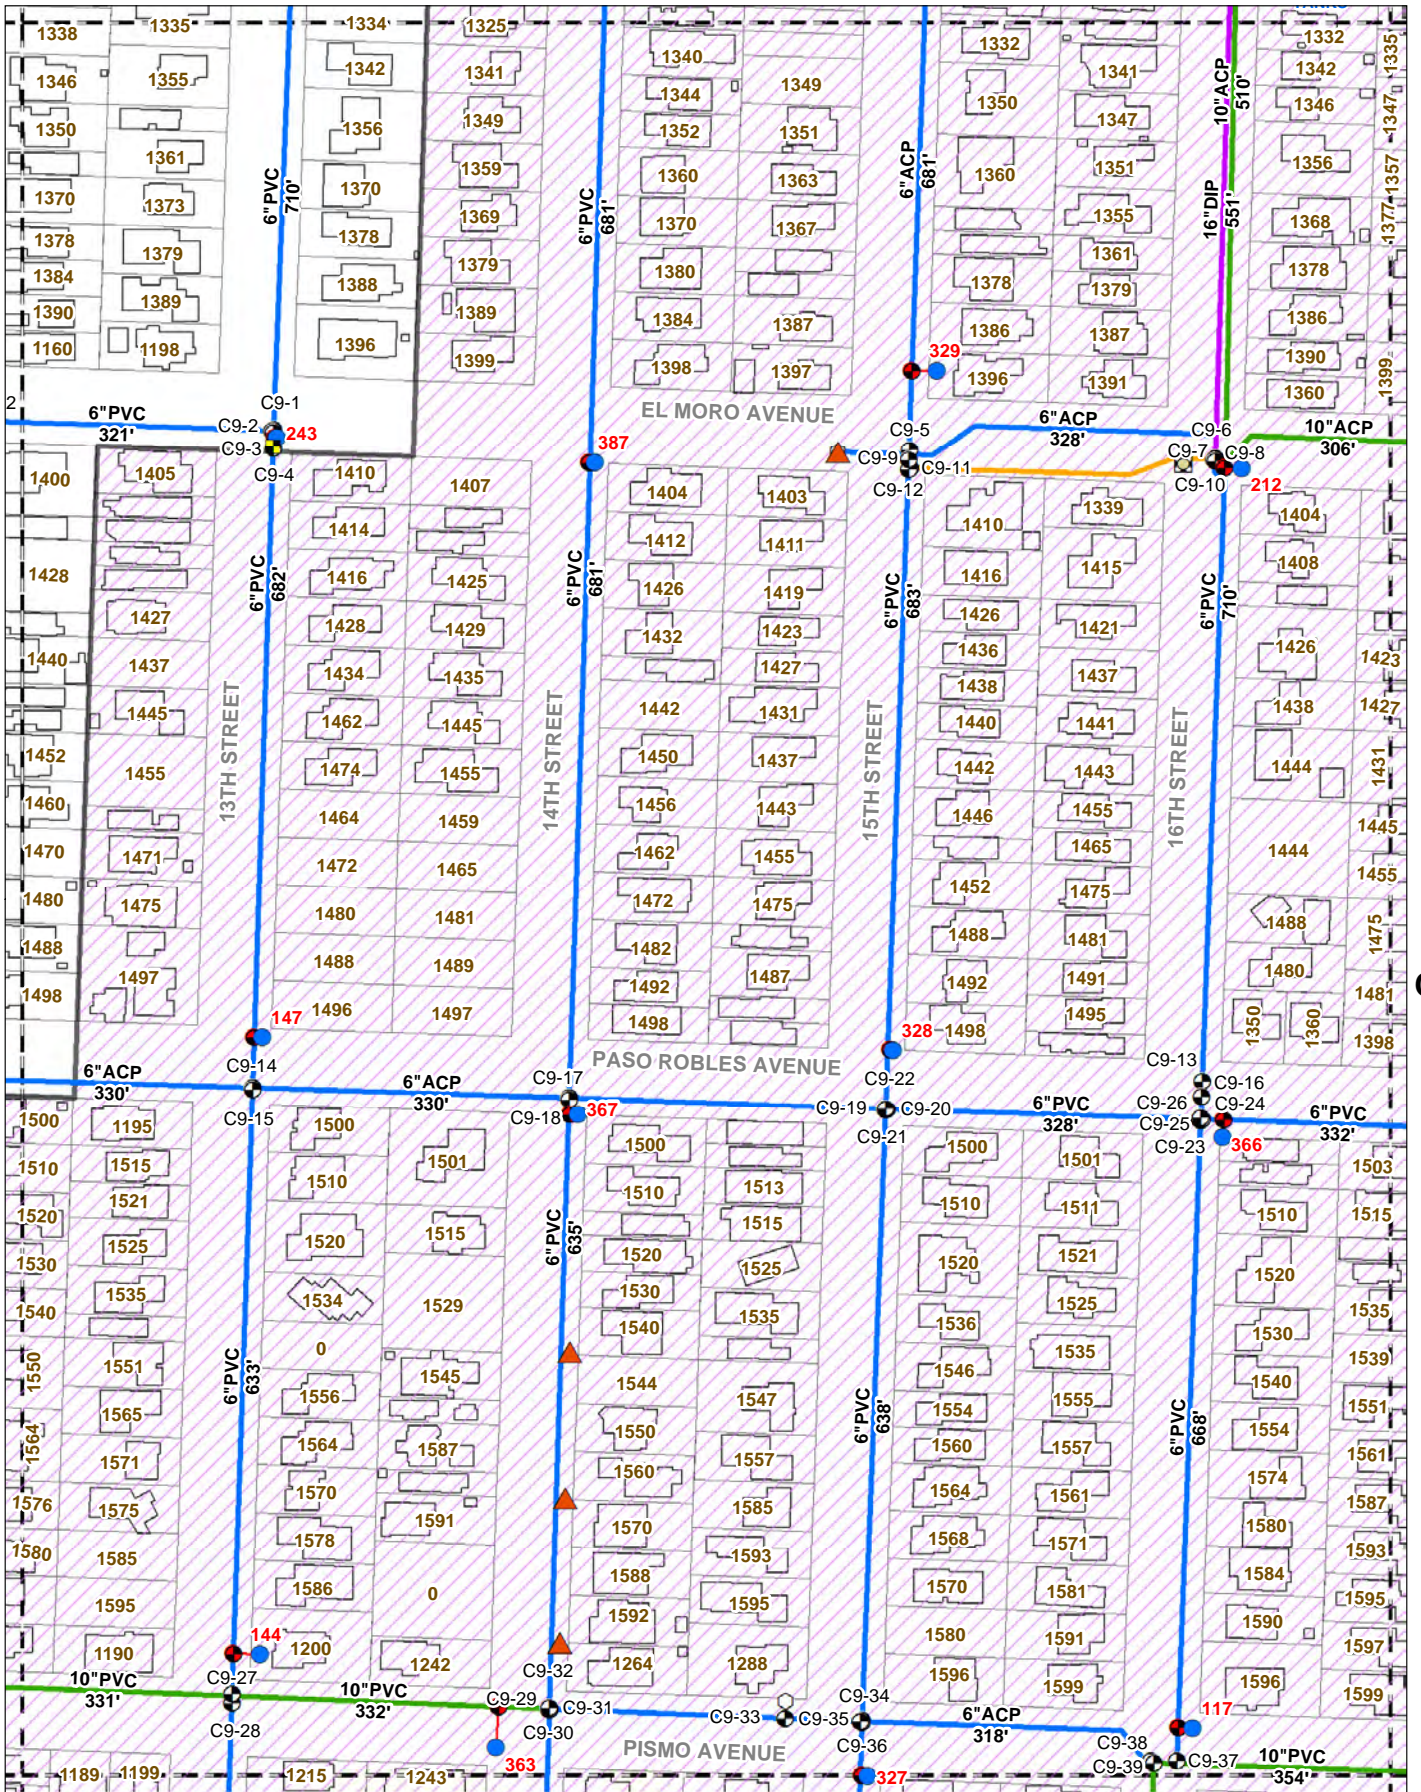

C8

C10



D9

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: C9



1 inch = 200 feet




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C10

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C10-1	6		10/31/2011	RF/RD	19.8	Turns Freely	
C10-2	10		10/31/2011	RF/RD	32.1	Turns Freely	
C10-3	6		10/31/2011	RF/RD	22.3	Turns Freely	
C10-4	6		10/31/2011	RF/RD	25.8	Turns Freely	Two valves numbered 346; one at Nipomo & El Moro, one at 18th & El Moro?
C10-5	10		11/2/2011	WHS/RD	32.1	Sticky	
C10-6	10		11/2/2011	WHS/RD	32	Turns Freely	
C10-7	10				0		
C10-8	6		10/28/2011	RF	20.2	Turns Freely	
C10-9	6		10/28/2011	RF	20.3	Turns Freely	
C10-10	6		10/28/2011	RF	19.8	Turns Freely	

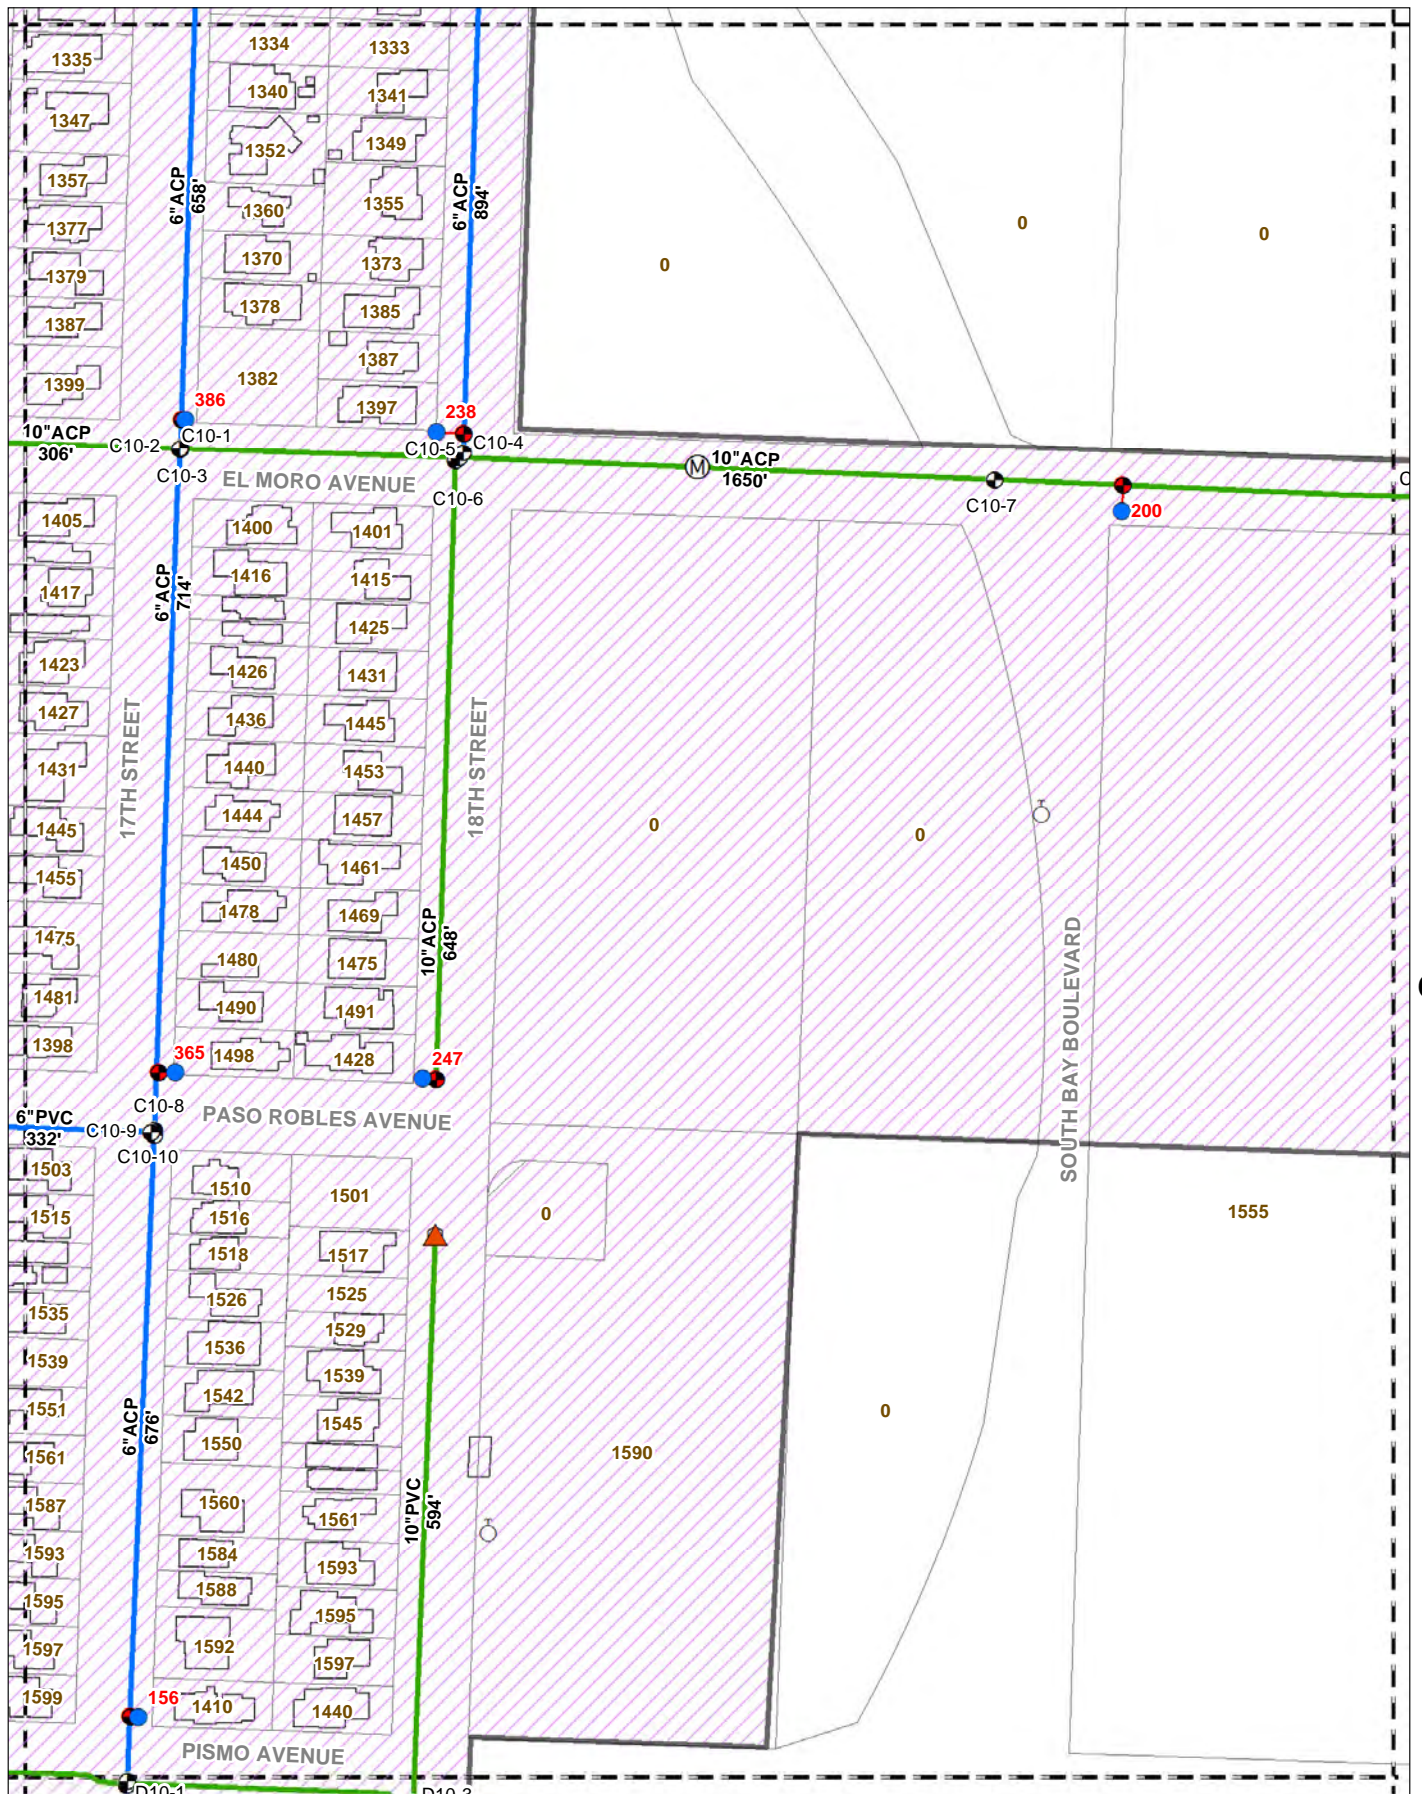

C9



C11

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM

SHEET: C10



1 inch = 200 feet




MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			


LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET C11

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
C11-1	10				0		the valve books
C11-2	10				0		
C11-3	8				0		

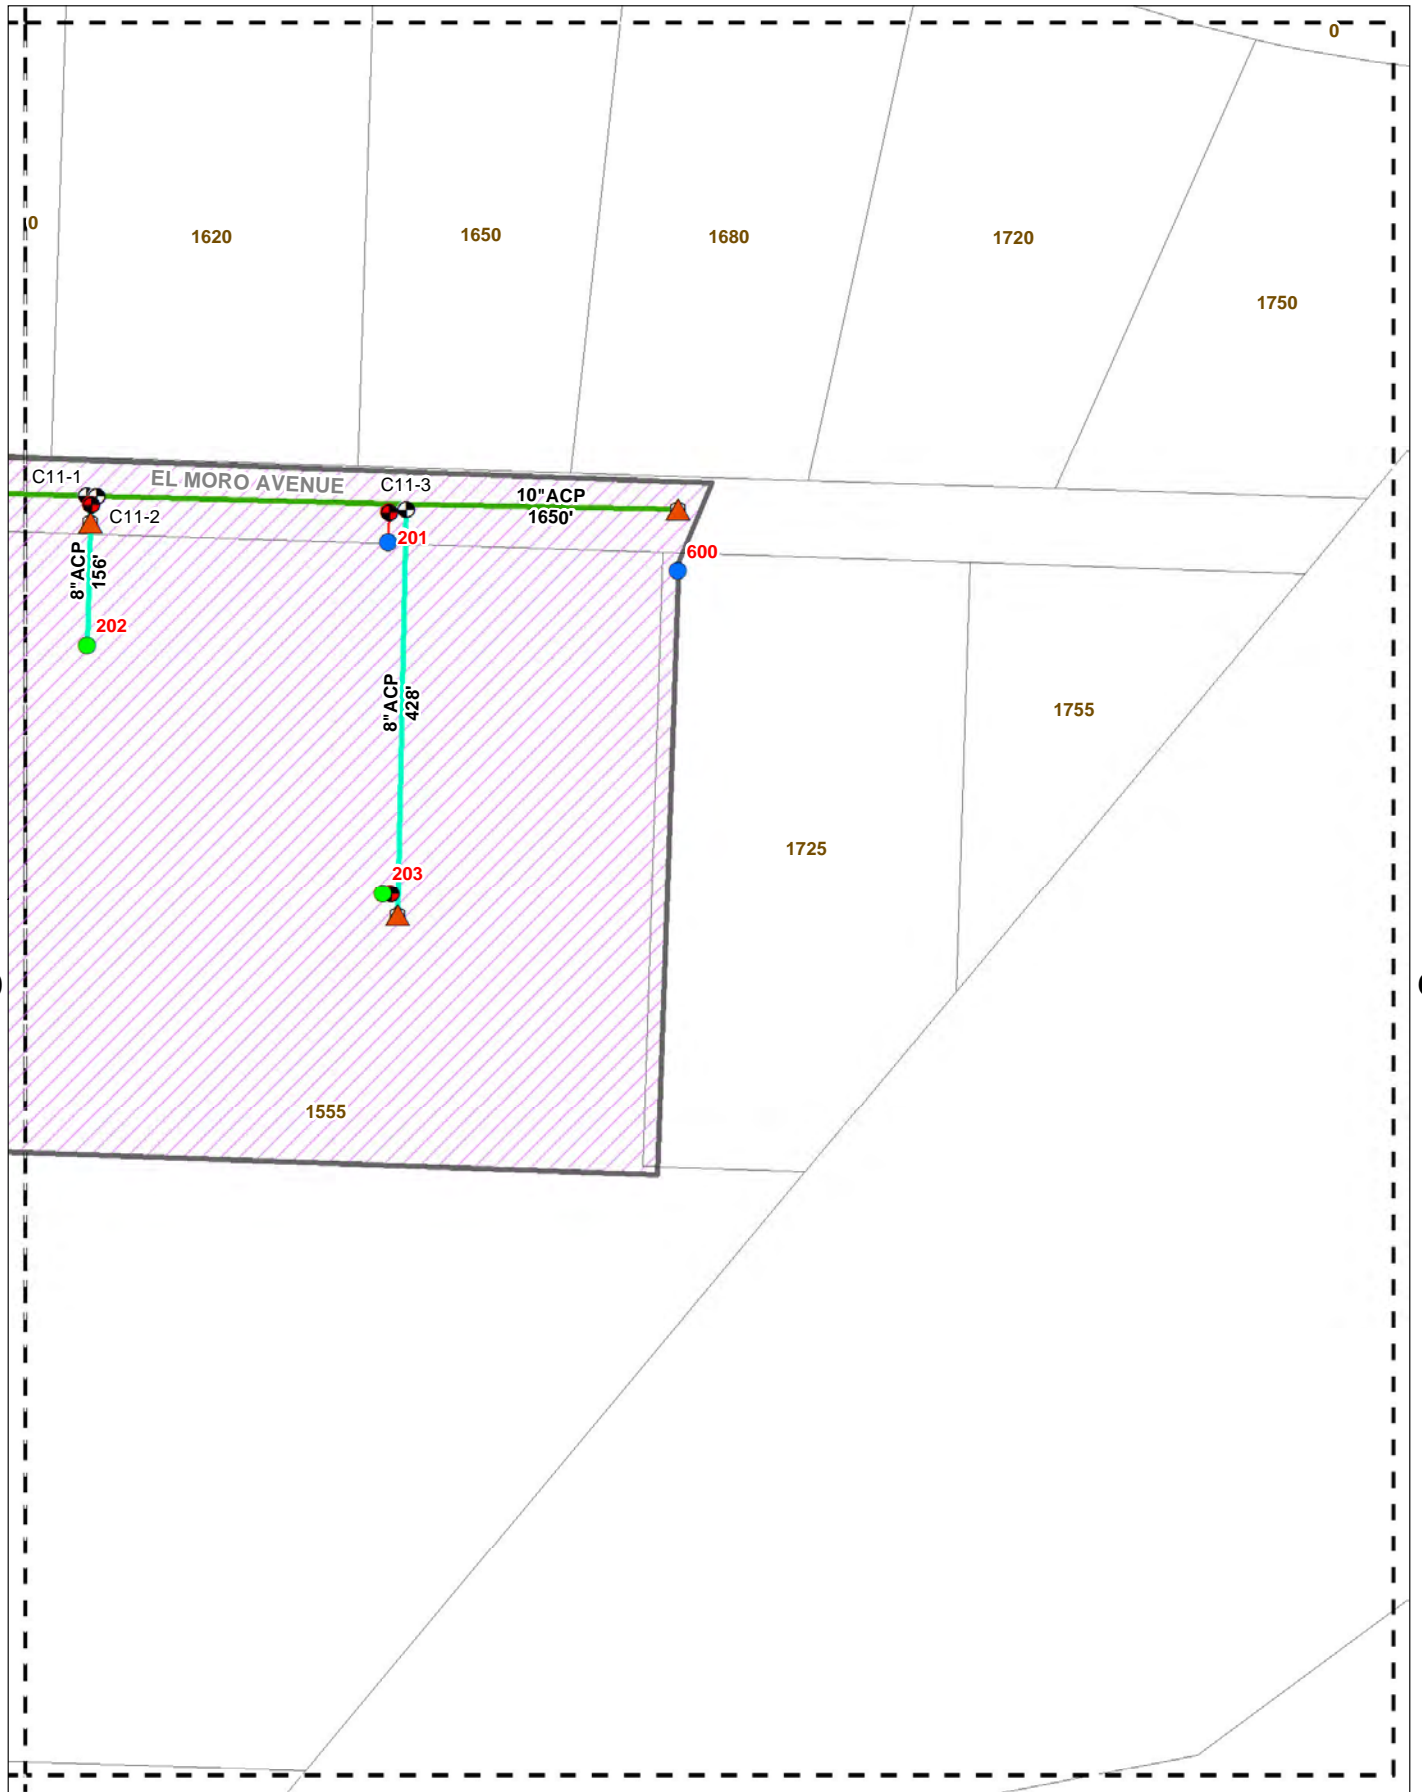


C10

C12



D11
 LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: C11




WALLACE GROUP®
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET D7

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
D7-1	6		10/15/2011	RD/NP	20.7	Turns Freely	
D7-2	8		10/15/2011	RD/NP	26.7	Turns Freely	
D7-3	10		10/15/2011	RD/NP	26.2	High Resistance	
D7-4	10		10/15/2011	RD/NP	19.6	Turns Freely	
D7-5	10		10/15/2011	RD/NP	19.5	Turns Freely	
D7-6	6		10/17/2011	RF	20.5	Turns Freely	
D7-7	10		10/15/2011	RD/NP	32	Turns Freely	
D7-8	6		10/17/2011	RF	20.8	Turns Freely	
D7-9	6		10/17/2011	RF	21.2	Turns Freely	
D7-10	8		10/18/2011	RF	26.2	Turns Freely	
D7-11	6		10/18/2011	RF	20.2	Sticky Backing Up	
D7-12	10		10/18/2011	RF	32.3	Turns Freely	
D7-13	10		10/18/2011	RF	31.6	Turns Freely	
D7-14	6		10/17/2011	RF	21	Turns Freely	
D7-15	10		10/15/2011	RD/NP	19.3	Turns Freely	
D7-16	10		10/18/2011	RF	31.5	Turns Freely	
D7-17	6		10/17/2011	RF	21	Turns Freely	
D7-18	6				0		Old Information that have object ID's but doesn't correspond to anything in

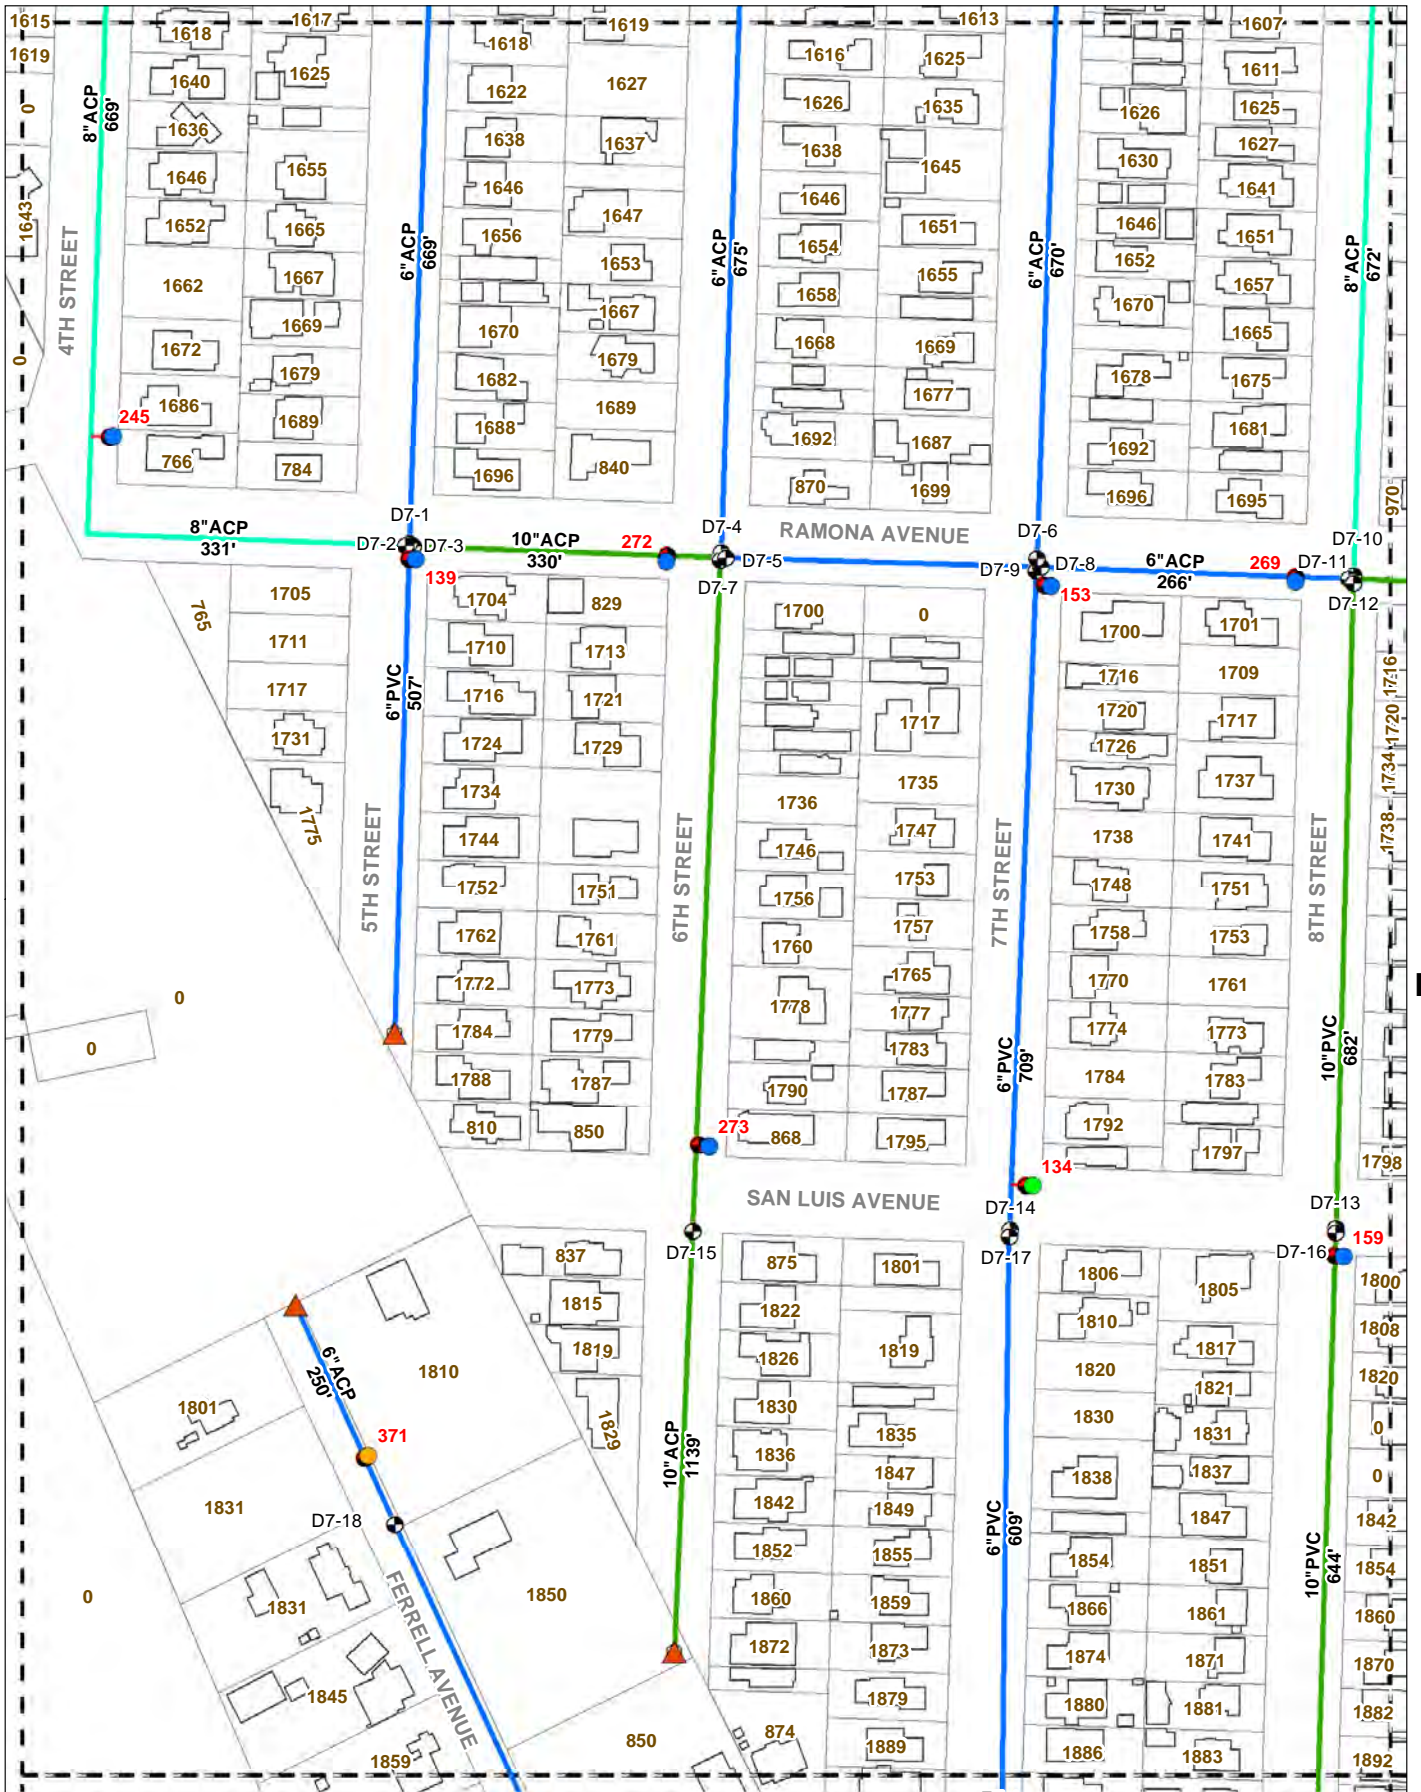

D6



D8

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: D7



1 inch = 200 feet




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET D8

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
D8-1	6		10/24/2011	RF/NP	19	Turns Freely	
D8-2	6		10/18/2011	RF	20.4	Low Resistance	
D8-3	6		10/18/2011	RF	19.4	Low Resistance	
D8-4	6		10/18/2011	RF	20.4	High Resistance	
D8-5	10		10/20/2011	WHS/RF	32.3	Turns Freely	
D8-6	10	Mueller			0		
D8-7	6		10/20/2011	WHS/RF	27.4	Turns Freely	
D8-8	10		10/20/2011	WHS/RF	27.4	Turns Freely	
D8-9	6		10/21/2011	RF/NP	20	Turns Freely	
D8-10	6		10/21/2011	RF/NP	20.8	Turns Freely	
D8-11	6		10/24/2011	RF/NP	19.9	Turns Freely	
D8-12	6		10/24/2011	RF/NP	19.8	Turns Freely	
D8-13	6		10/24/2011	RF/NP	35.3	Turns Freely	
D8-14	4		10/21/2011	RF/NP	20.3	Turns Freely	
D8-15	6		10/18/2011	RF	19.4	Turns Freely	
D8-16	6		10/18/2011	RF	19.2	Turns Freely	
D8-17	6		10/20/2011	WHS/RF	20	Turns Freely	
D8-18	10		10/20/2011	WHS/RF	32.2	Moderate	
D8-19	10		10/24/2011	RF/NP	20.5	Turns Freely	
D8-20	10		10/24/2011	RF/NP	31.6	Turns Freely	

C8

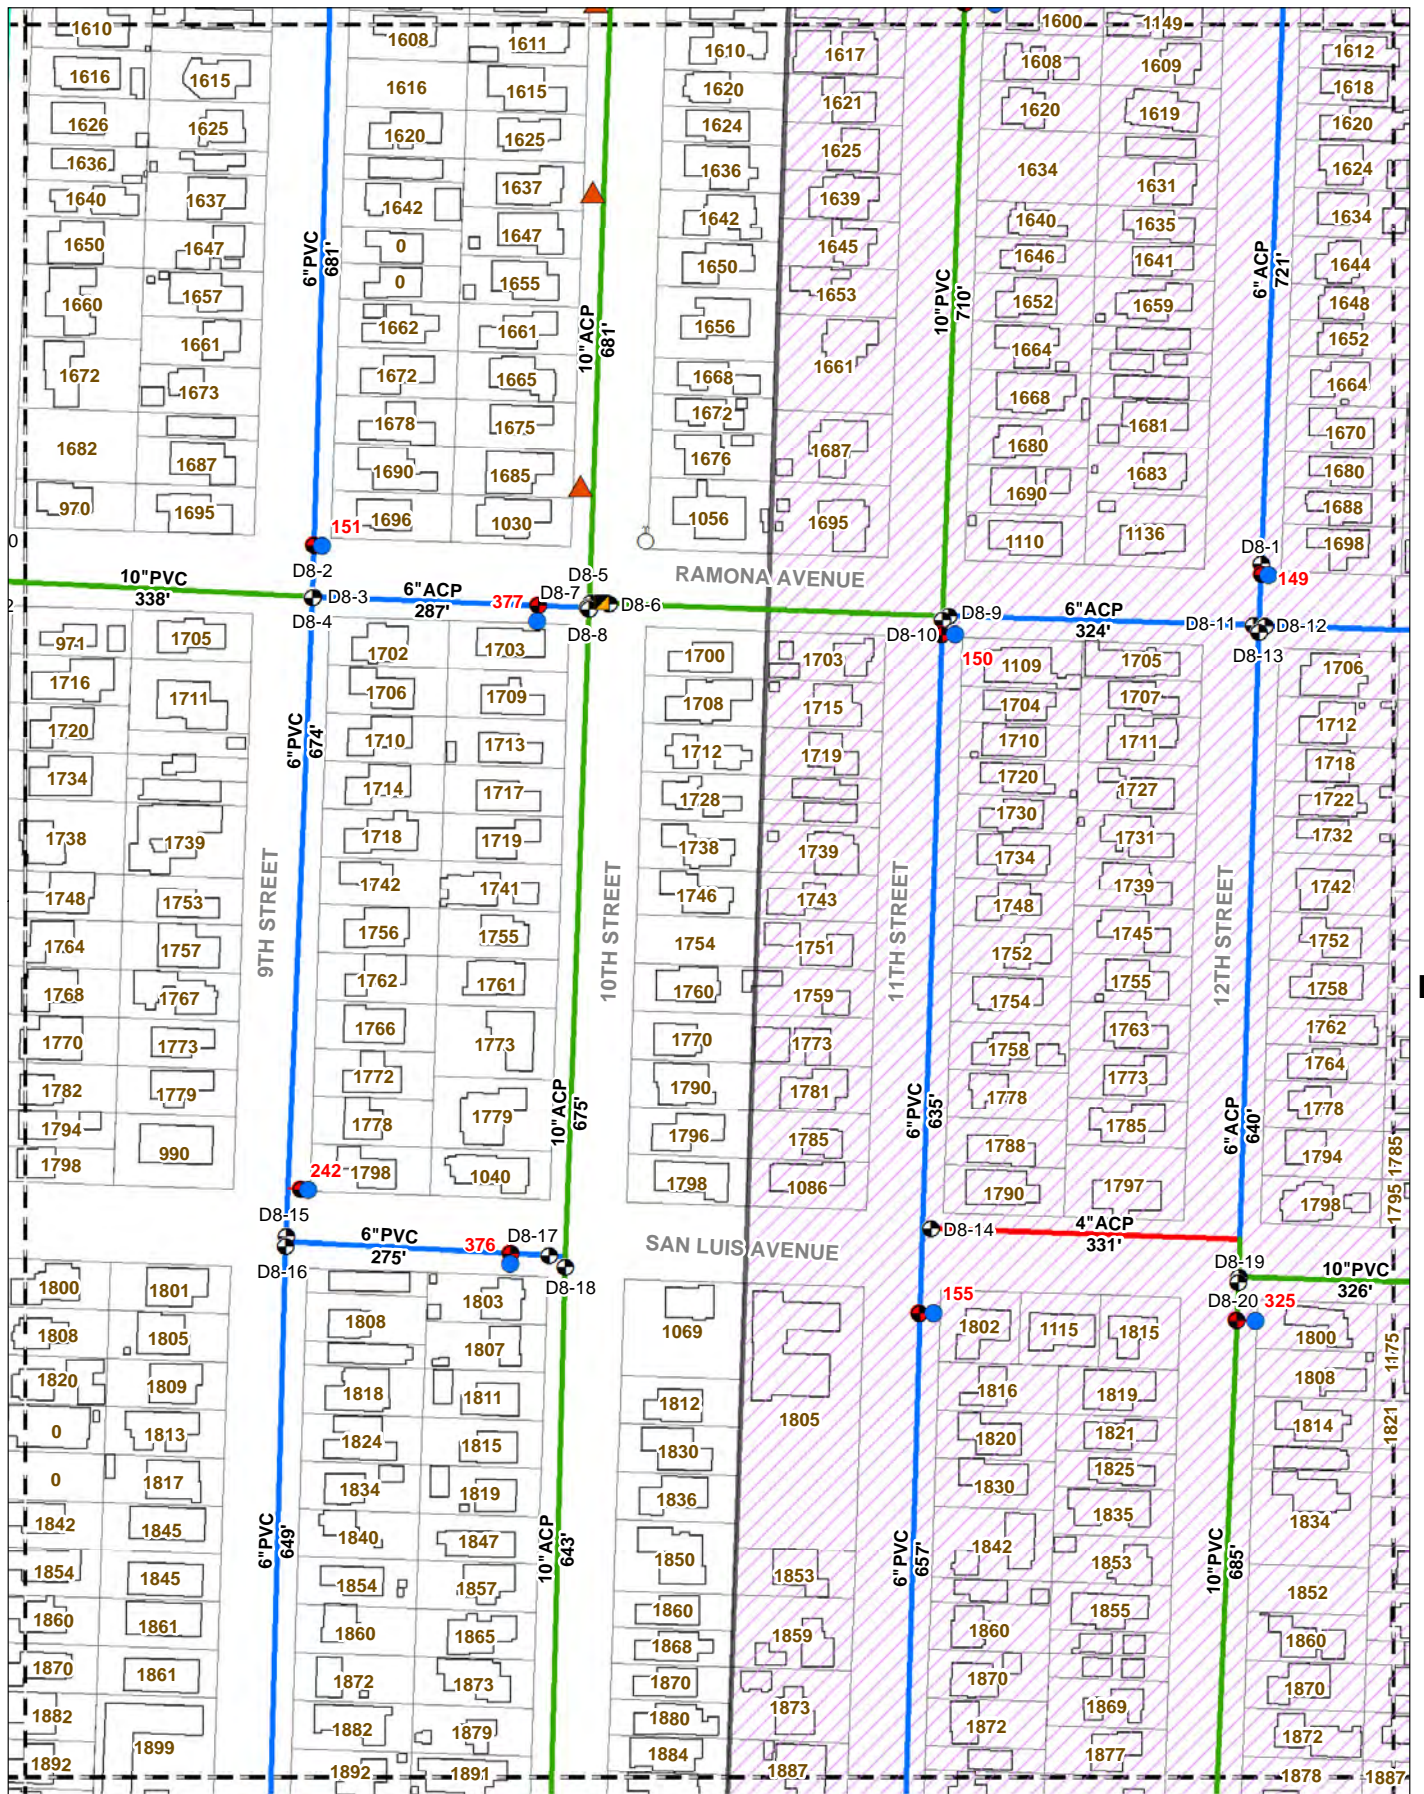



D7

D9

E8

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: D8




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET D9

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	URNS	CONDITION	COMMENT
D9-1	10		10/26/2011	RF	31.8	Turns Freely	
D9-2	6		10/25/2011	WHS/RF	19.6	Turns Freely	
D9-3	6		10/25/2011	WHS/RF	20	Turns Freely	
D9-4	6		10/25/2011	WHS/RF	20	Low Resistance	
D9-5	6		10/25/2011	WHS/RF	19.8	Low Resistance	
D9-6	6		10/25/2011	WHS/RF	0	Unable to Locate	
D9-7	6		10/26/2011	WHS/RF	20.5	Turns Freely	
D9-8	6		10/26/2011	WHS/RF	20.3	Turns Freely	
D9-9	10		10/26/2011	WHS/RF	20.2	Turns Freely	
D9-10	4		10/26/2011	WHS/RF	20.3	Turns Freely	
D9-11	10		10/26/2011	RF	30.7	Turns Freely	
D9-12	10		10/26/2011	RF	32.5	Turns Freely	
D9-13	6		10/25/2011	WHS/RF	21.4	Turns Freely	
D9-14	6		10/25/2011	WHS/RF	21.2	Turns Freely	
D9-15	10		10/25/2011	WHS/RF	32.5	Turns Freely	
D9-16	10		10/25/2011	WHS/RF	32.4	Turns Freely	
D9-17	6		10/25/2011	WHS/RF	20.9	Turns Freely	
D9-18	6		10/25/2011	WHS/RF	20.7	Turns Freely	

C9

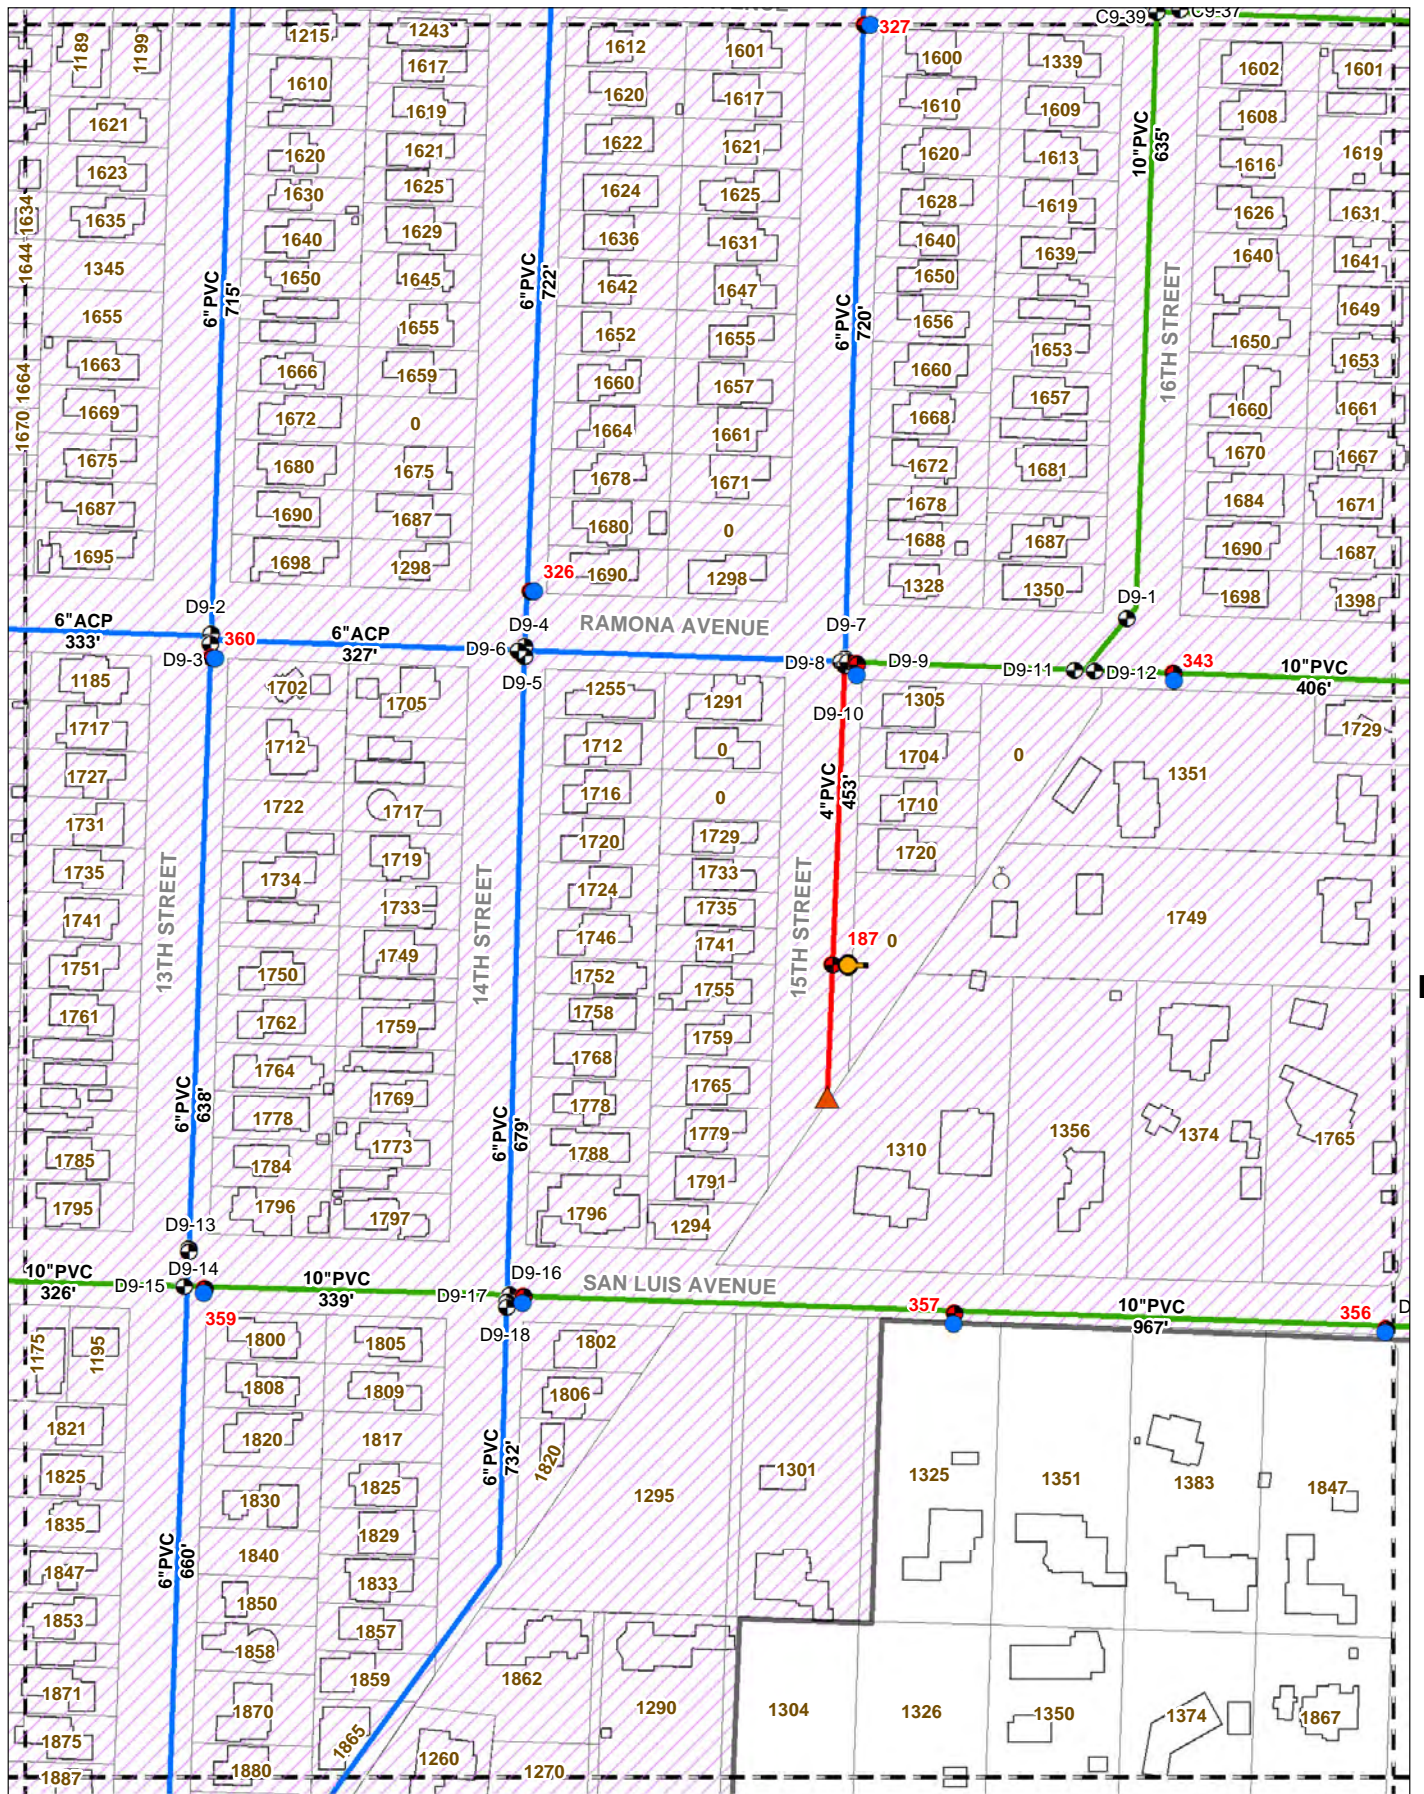



D8

D10

E9

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: D9




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET D10

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	URNS	CONDITION	COMMENT
D10-1	6		10/28/2011	RF	19.9	Turns Freely	
D10-2	6		10/28/2011	RF	20.1	Turns Freely	Was Valve number 341
D10-3	10		11/2/2011	RD	32.2	Turns Freely	
D10-4	6		11/2/2011	RD	20	Turns Freely	
D10-5	6		10/28/2011	RF	20	Turns Freely	
D10-6	6		10/28/2011	RF	33	Turns Freely	
D10-7	10		10/31/2011	RF/RD	31.8	Turns Freely	
D10-8	10		10/31/2011	RF/RD	26.1	Low Resistance	

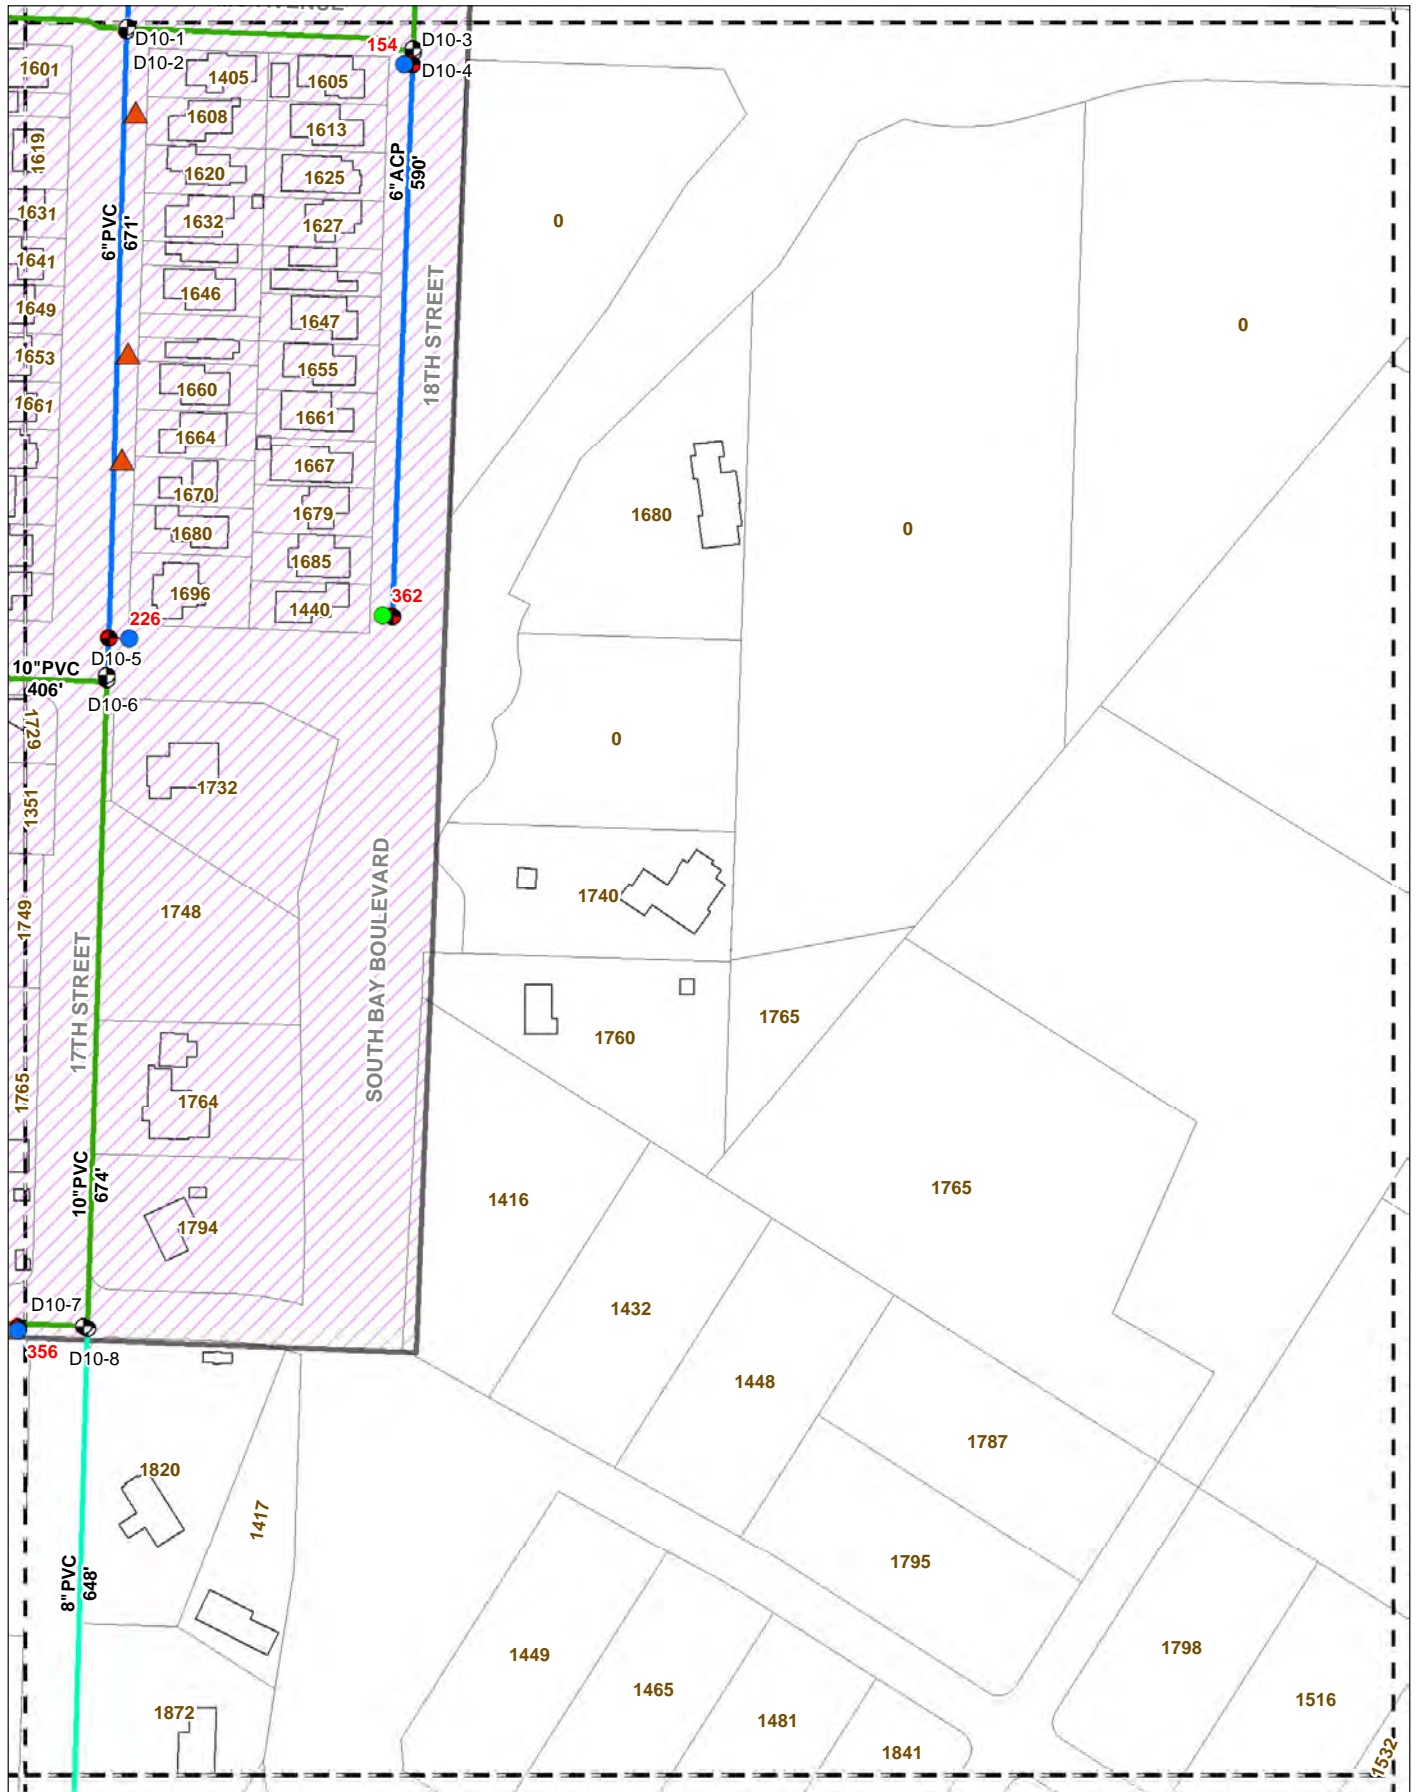



D9

D11

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM



1 inch = 200 feet




WALLACE GROUP®
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	D11
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET E7

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
E7-1	6		10/17/2011	RF	20.5	Turns Freely	
E7-2	6		10/17/2011	RF	19.4	Turns Freely	
E7-3	6		10/17/2011	RF	20.4	Turns Freely	
E7-4	10		10/17/2011	RF	26.8	Turns Freely	
E7-5	6		10/17/2011	RF/RD	21	Turns Freely	
E7-6	10		10/17/2011	RF/RD	31	Turns Freely	
E7-7	12		10/17/2011	RF/RD	34.1	Turns Freely	
E7-8	6		10/17/2011	RF	20.3	Turns Freely	
E7-9	6		10/19/2011	WHS/RF	19.9	Turns Freely	
E7-10	6		3/1/2002	FA	20	Replaced Canister	
E7-11	6	Mueller	10/19/2011	WHS/RF	21.3	Turns Freely	
E7-12	6	Mueller	10/19/2011	WHS/RF	21.2	Turns Freely	
E7-13	8		10/19/2011	WHS/RF	26.8	Turns Freely	
E7-14	8		10/19/2011	WHS/RF	26.9	Turns Freely	
E7-15	6		10/17/2011	RF/RD	20.5	Turns Freely	HAD CROSS LOCATION AS FERRELL
E7-16	6		10/17/2011	RF/RD	20.2	Turns Freely	HAD CROSS LOCATION AS FERRELL
E7-17	8		10/19/2011	WHS/RF	27.3	Moderate	

D7

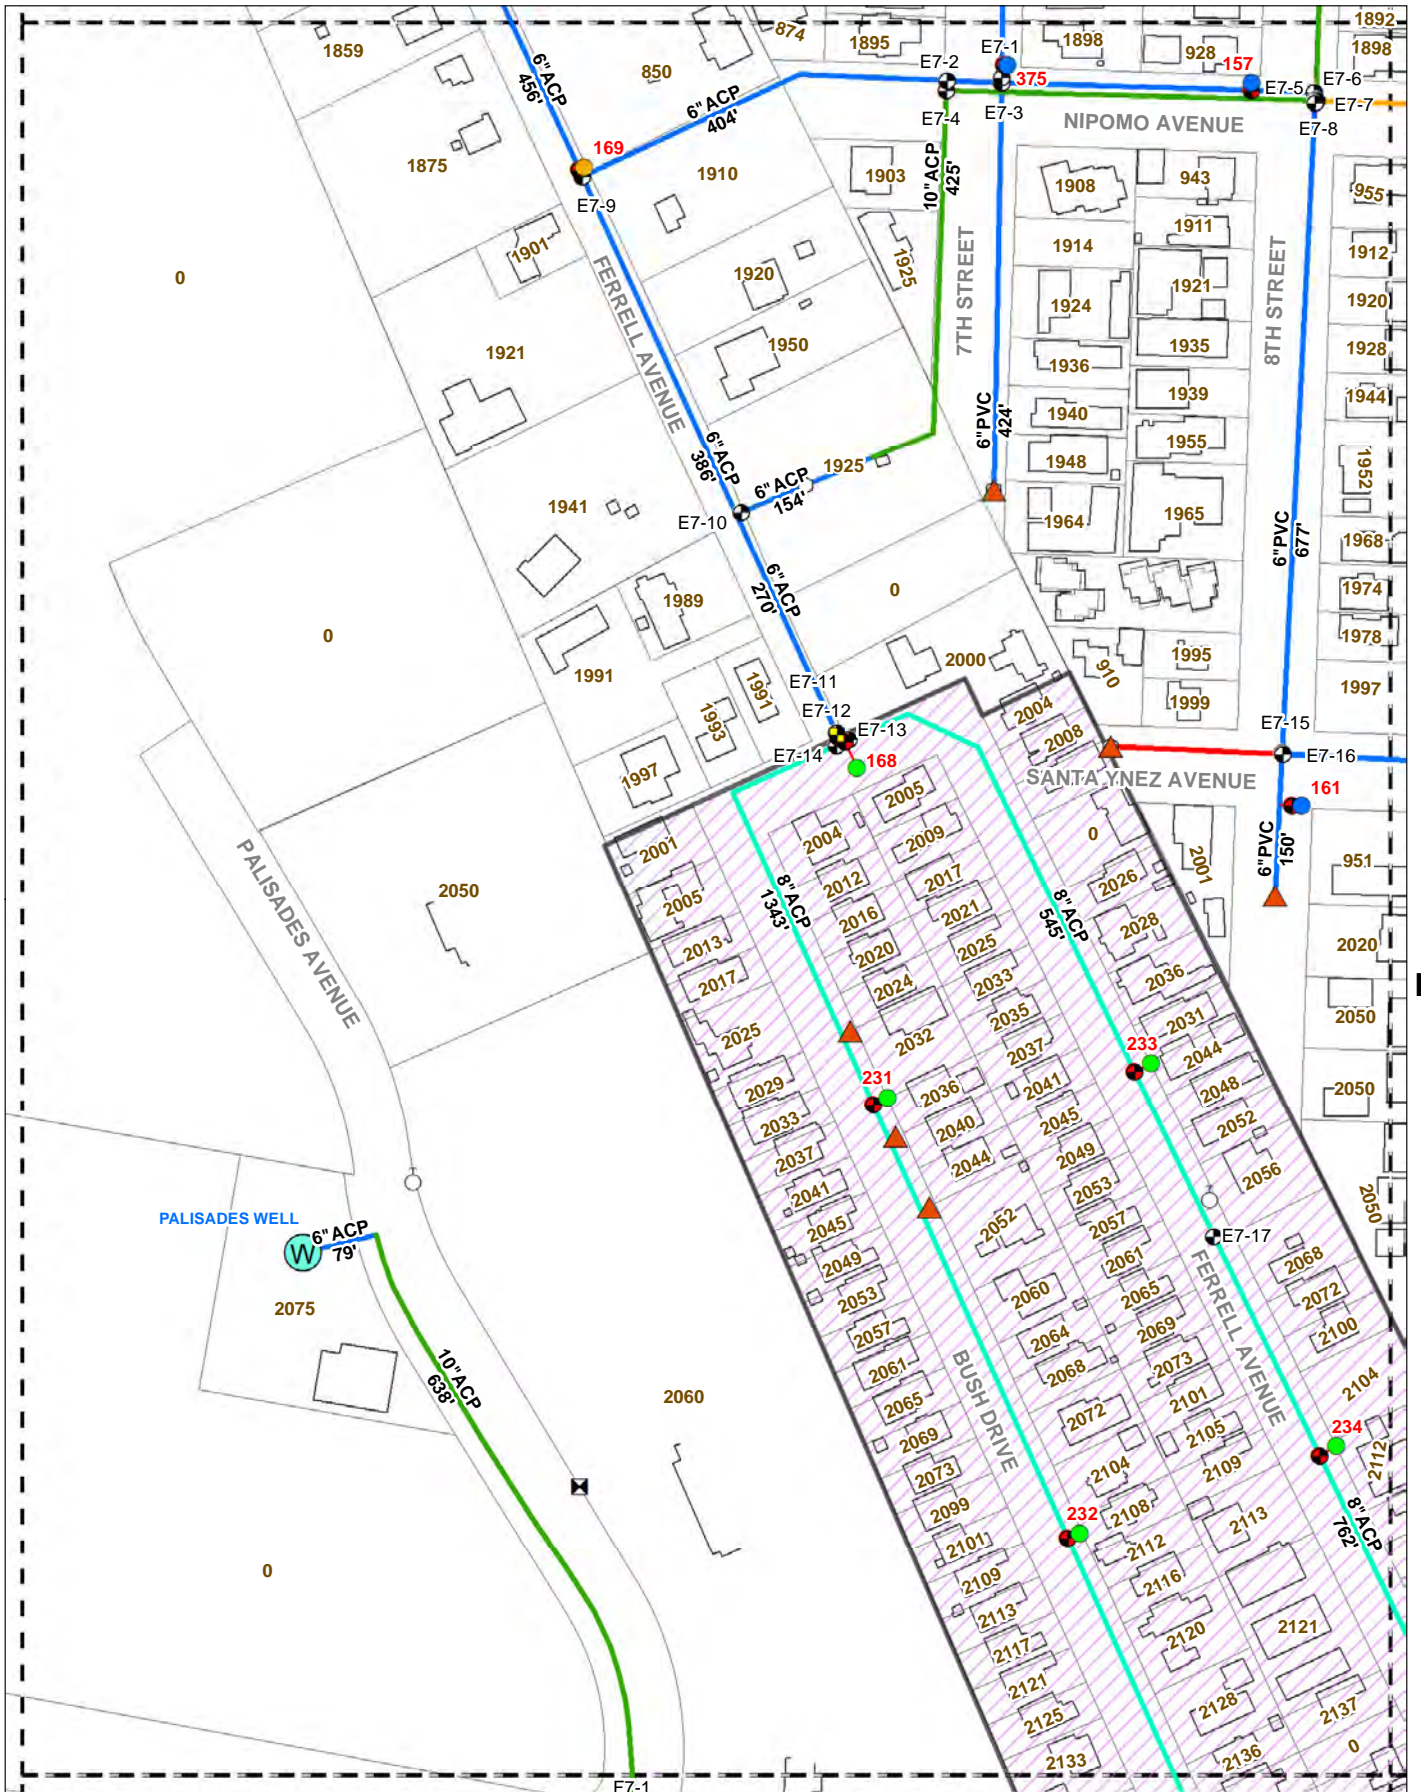



E6

E8

F7

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM

SHEET: E7



WALLACE GROUP
MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			


LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET E8

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
E8-1	6		10/21/2011	RF/NP	19.25	Turns Freely	
E8-2	6		10/19/2011	WHS/RF	18.9	Turns Freely	
E8-3	12		10/19/2011	WHS/RF	38.6	Turns Freely	
E8-4	10		10/19/2011	WHS/RF	32.2	Turns Freely	
E8-5	10		5/3/2004	FA/RK	0	Covered	
E8-6	6		5/3/2004	FA/RK	0	Covered	
E8-7	10		5/3/2004	FA/RK	0	Covered	
E8-8	6	Mueller	10/20/2011	WHS/RF	21.4	Turns Freely	
E8-9	6		10/21/2011	RF/NP	20.3	Turns Freely	
E8-10	6		3/29/2002	FA/RK	20	Turns Freely	Not Exercised 2011
E8-11	10		5/3/2004	FA/RK	26	Turns Freely	
E8-12	6		10/24/2011	RF/NP	19.8	Turns Freely	
E8-13	10		10/24/2011	RF/NP	31.5	Turns Freely	
E8-14	10		2/8/2002	FA/RK	30	Turns Freely	
E8-15	6		2/8/2002	FA/RK	19	Turns Freely	
E8-16	10		11/2/2011	WHS/RD	32	Turns Freely	
E8-17	10	Mueller	11/2/2011	WHS/RD	30.5	Sticky at End	
E8-18	16	Mueller	11/2/2011	WHS/RD	31.8	Turns Freely	
E8-19	10		10/20/2011	WHS/RF	32.1	Turns Freely	
E8-20	10		10/20/2011	WHS/RF	31.8	Turns Freely	
E8-21	10	Mueller	10/20/2011	WHS/RF	32.8	Turns Freely	
E8-22	10		10/20/2011	WHS/RF	26.3	Turns Freely	
E8-23	8	Mueller	10/20/2011	WHS/RF	27.5	Turns Freely	
E8-24	10		10/21/2011	RF/NP	31.6	Turns Freely	
E8-25	10		10/21/2011	RF/NP	31.6	Turns Freely	
E8-26	8		10/21/2011	RF/NP	10.2	Valve Half Closed	Valve won't open
E8-27	10		10/24/2011	RF/NP	31.6	Turns Freely	
E8-28	12	Mueller	11/1/2011	RF/RD/WHS	39.3	Turns Freely	
E8-29	12	Mueller	11/1/2011	RF/RD/WHS	38.6	Turns Freely	
E8-30	12	Mueller	11/1/2011	RF/RD/WHS	38.8	Turns Freely	12" Gate Valve Boosted Zone
E8-31	12	Mueller	11/1/2011	RF/RD/WHS	38.8	Turns Freely	12" Gate Valve Boosted Zone
E8-32	12	Mueller	11/1/2011	RF/RD/WHS	38.8	Turns Freely	12" Gate Valve Boosted Zone
E8-33	16	Mueller	11/1/2011	RF/RD/WHS	30.9	Turns Freely	16" Butterfly valve Gravity
E8-34	6		10/21/2011	RF/NP	21	Do Not Open	Intertie between Golden State and District
E8-35	12	Mueller	11/1/2011	RF/RD/WHS	38.5	Turns Freely	12" Gate Valve Gravity
E8-36	12	Mueller	11/2/2011	WHS/RD	38.8	Turns Freely	12" Gate Valve
E8-37	16	Mueller	11/1/2011	RF/RD/WHS	30.8	Turns Freely	16" Butterfly valve Gravity
E8-38	12	Mueller	11/2/2011	WHS/RD	27	Turns Freely	
E8-39	12	Mueller	11/2/2011	WHS/RD	27.2	Turns Freely	
E8-40	6	Mueller	11/2/2011	WHS/RD	21.1	Turns Freely	6" Gate Valve
E8-41	8	Mueller	10/20/2011	WHS/RF	27.4	Turns Freely	
E8-42	12	Mueller	10/20/2011	WHS/RF	39	Turns Freely	
E8-43	12	Mueller	10/20/2011	WHS/RF	0	closed	Closed for future expansion
E8-44	8	Mueller	10/20/2011	WHS/RF	27.3	Turns Freely	
E8-45	8		10/20/2011	WHS/RF	20.5	Turns Freely	Make sure 10th Street well is off when exercising
E8-46	8		10/20/2011	WHS/RF	0	High Resistance	Jocko & Mel said hard to turn but no # by it
E8-47	8		10/20/2011	WHS/RF	25.6	Hard to turn	

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET E9

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
E9-1	6		10/25/2011	WHS/RF	20	Turns Freely	
E9-2	6		10/25/2011	WHS/RF	20.4	Turns Freely	
E9-3	6		10/25/2011	WHS/RF	19.6	Turns Freely	
E9-4	6		10/25/2011	WHS/RF	20.1	Turns Freely	
E9-5	6				0		

D9

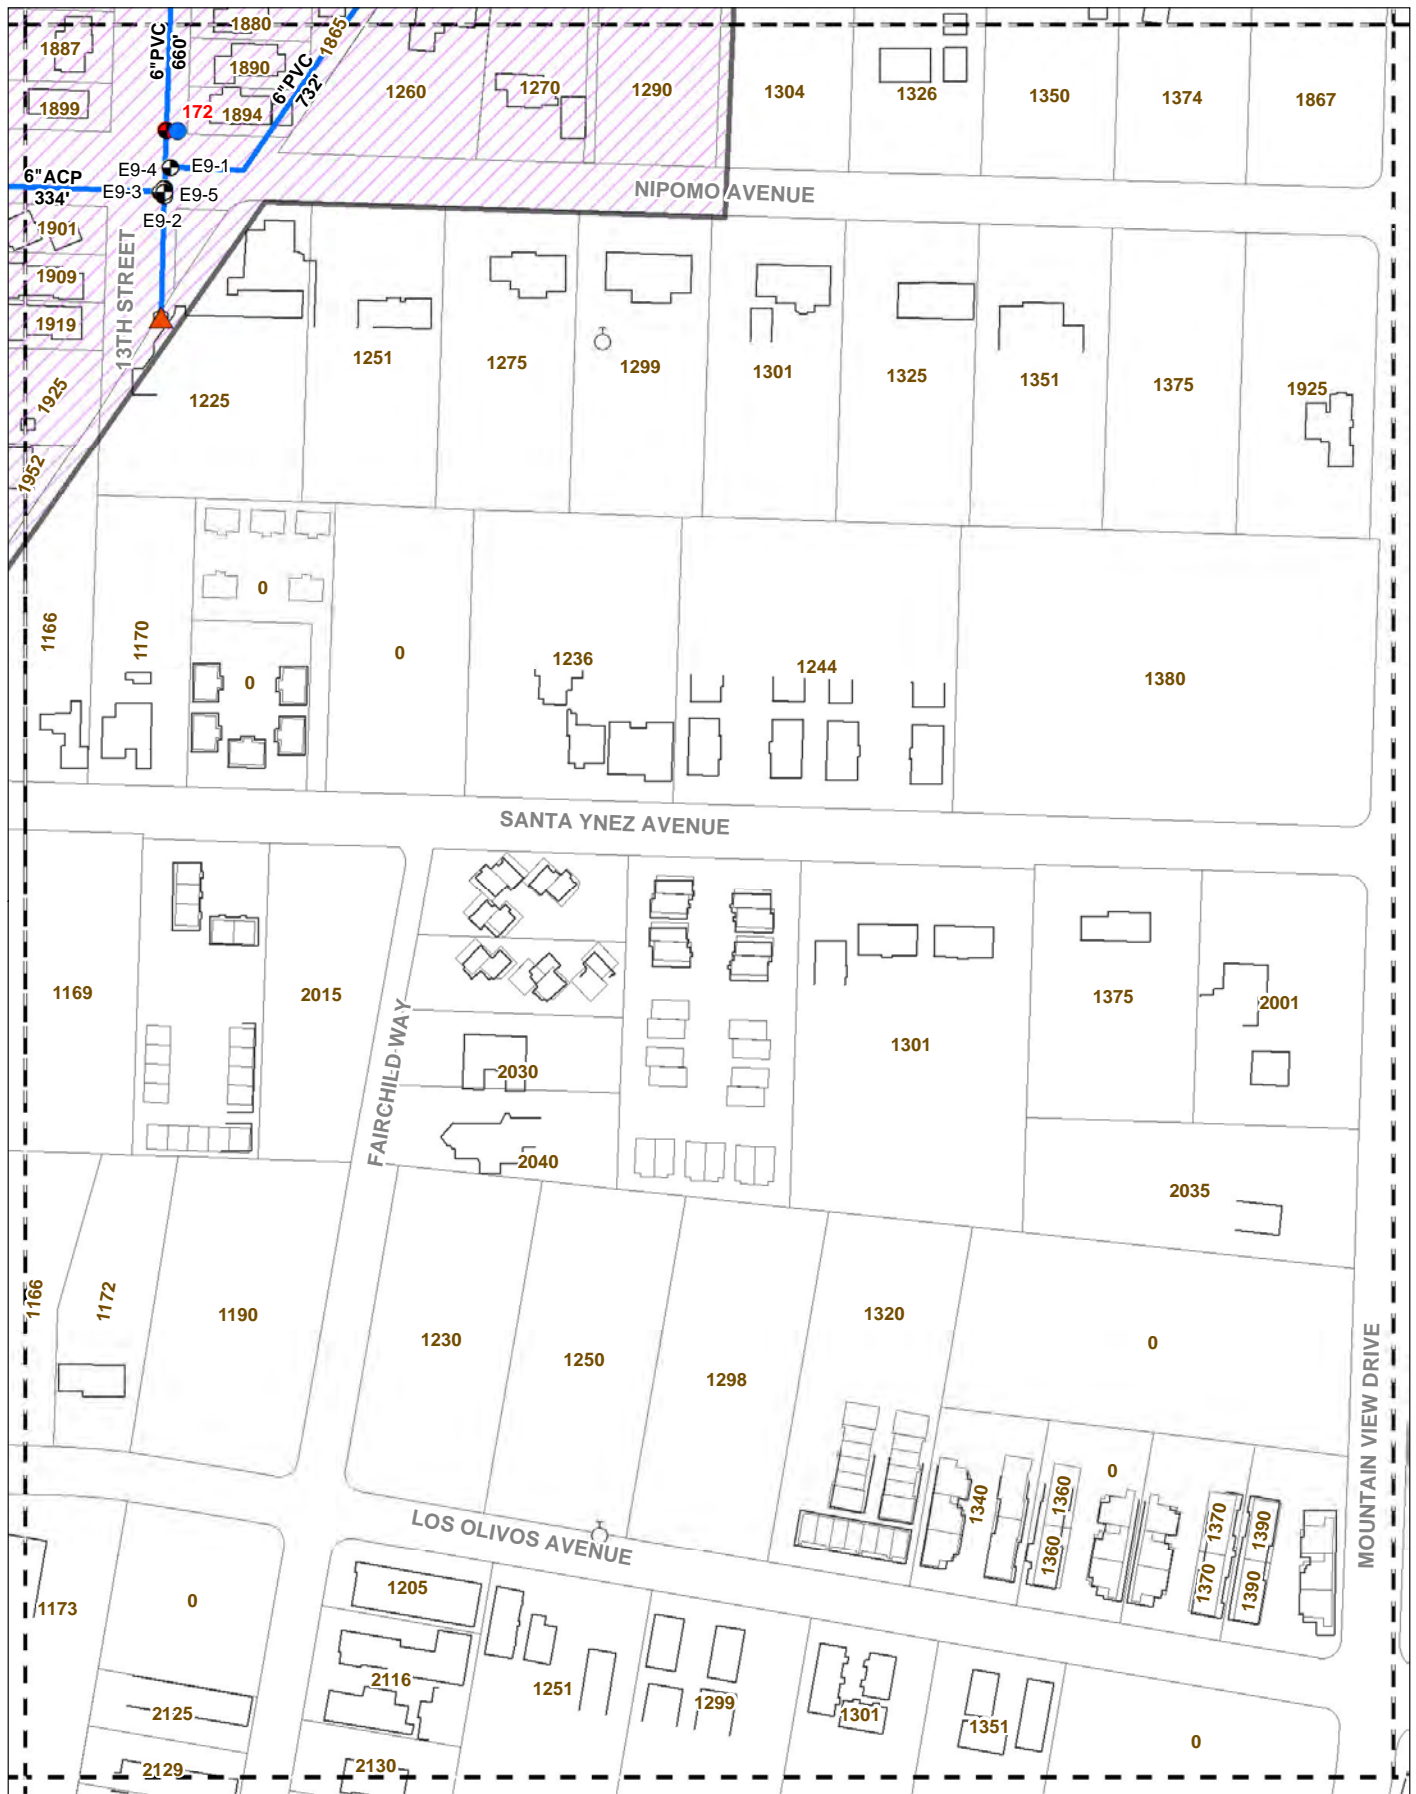

E8

E10



F9

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM

SHEET: E9



1 inch = 200 feet




WALLACE GROUP®
MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET E10

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
E10-1	8				0		
E10-2	8				0		the valve books

D10

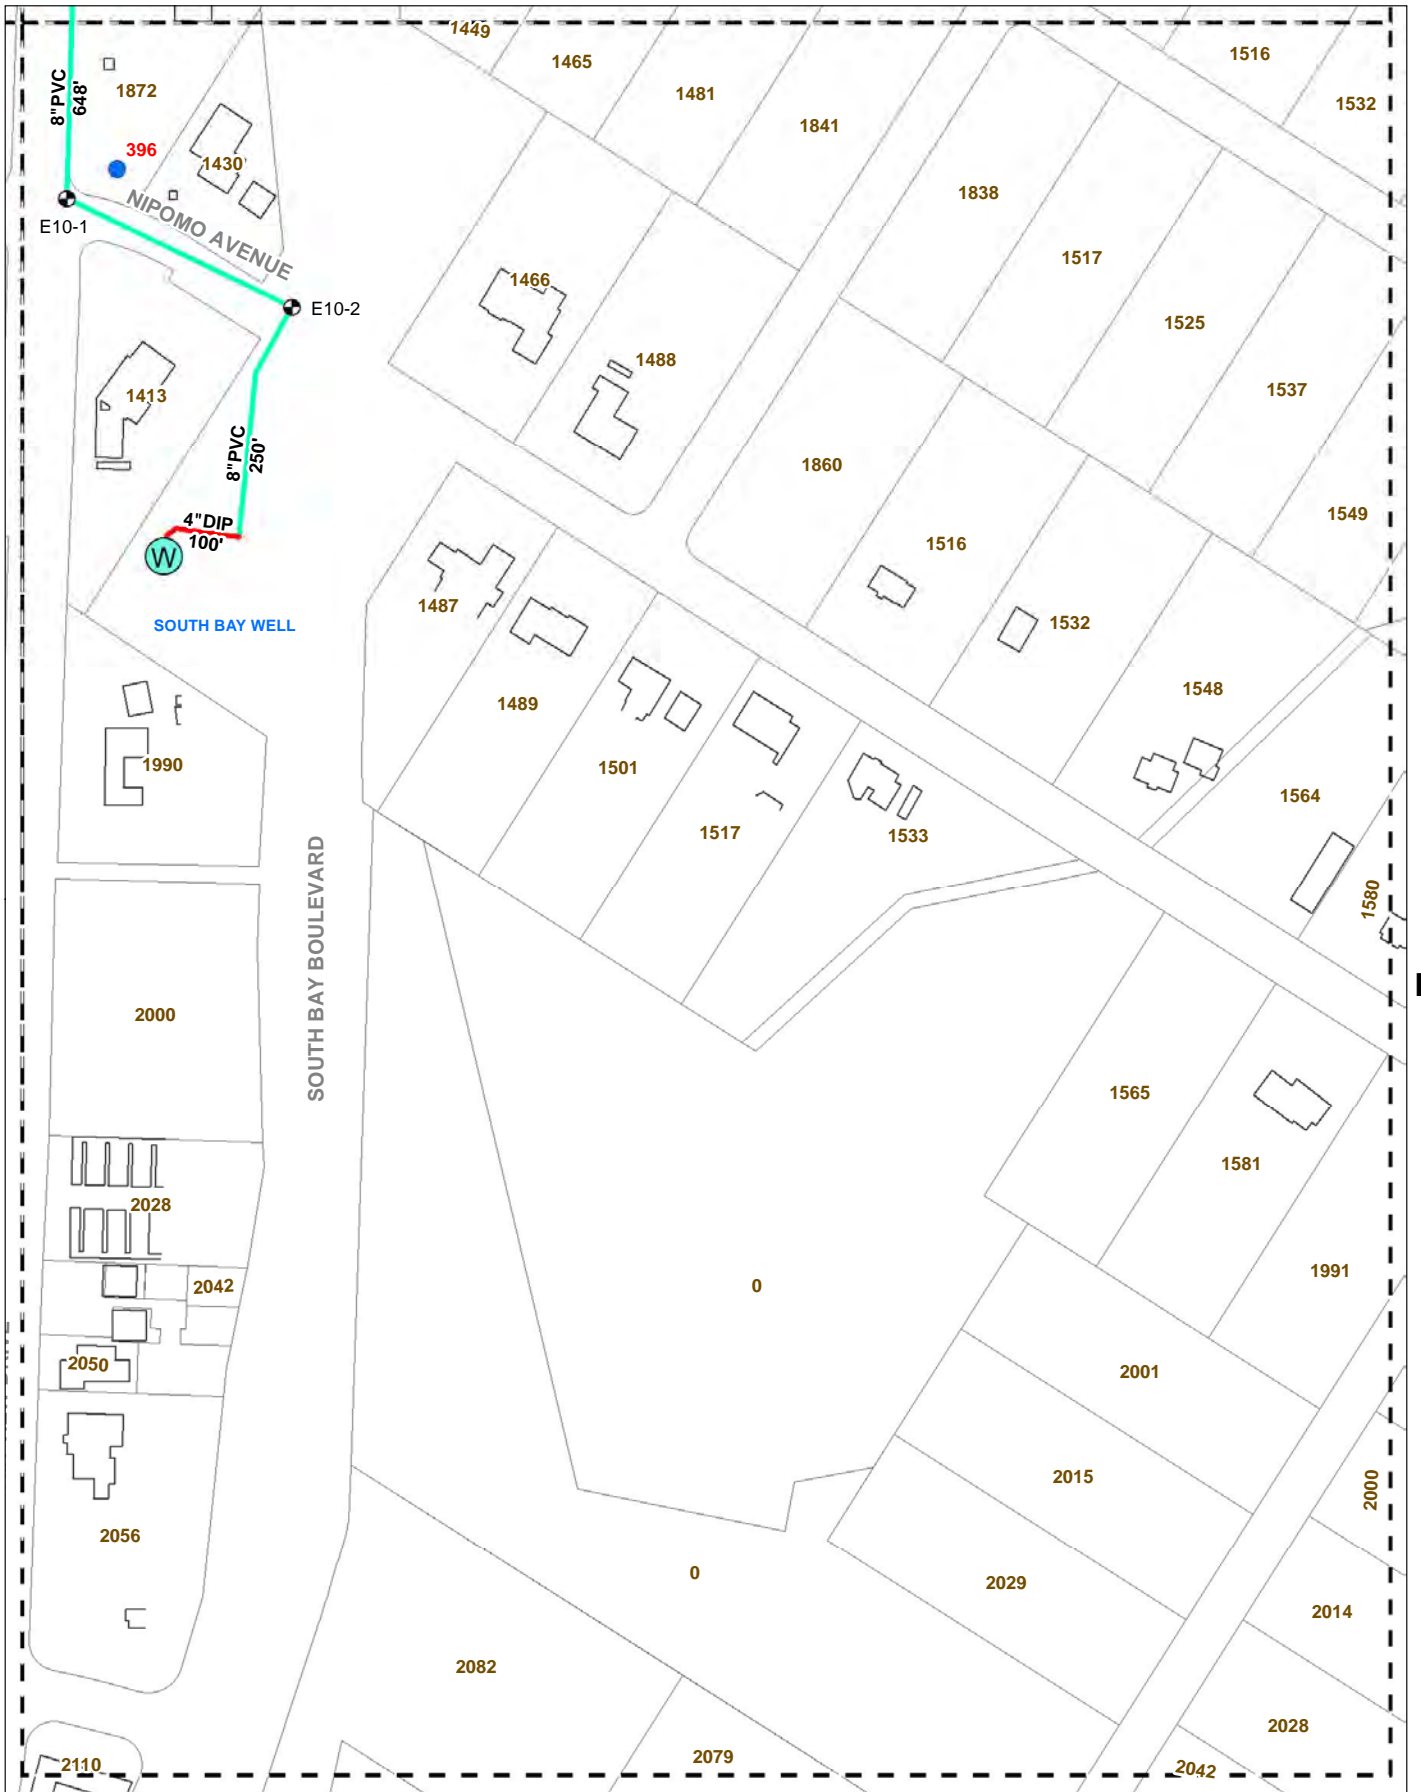

E9

E11



F10

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM

SHEET: E10



1 inch = 200 feet




WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET F7

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
F7-1	10	Mueller			0		
F7-2	6	Mueller			0		
F7-3	10	Mueller			0		
F7-4	16	Mueller			0		
F7-5	16	Mueller			0		
F7-6	16	Mueller			0		
F7-7	16	Mueller			0		
F7-8	8	Mueller	10/19/2011	WHS/RF	27.5	Turns Freely	
F7-9	8		10/19/2011	WHS/RF	21	Turns Freely	
F7-10	6	Mueller	11/1/2011	WHS/RF/RD	21.4	Turns Freely	
F7-11	16	Mueller	11/1/2011	WHS/RF/RD	30.9	Turns Freely	Butterfly Valve
F7-12	16	Mueller	11/1/2011	WHS/RF/RD	31	Turns Freely	

E7

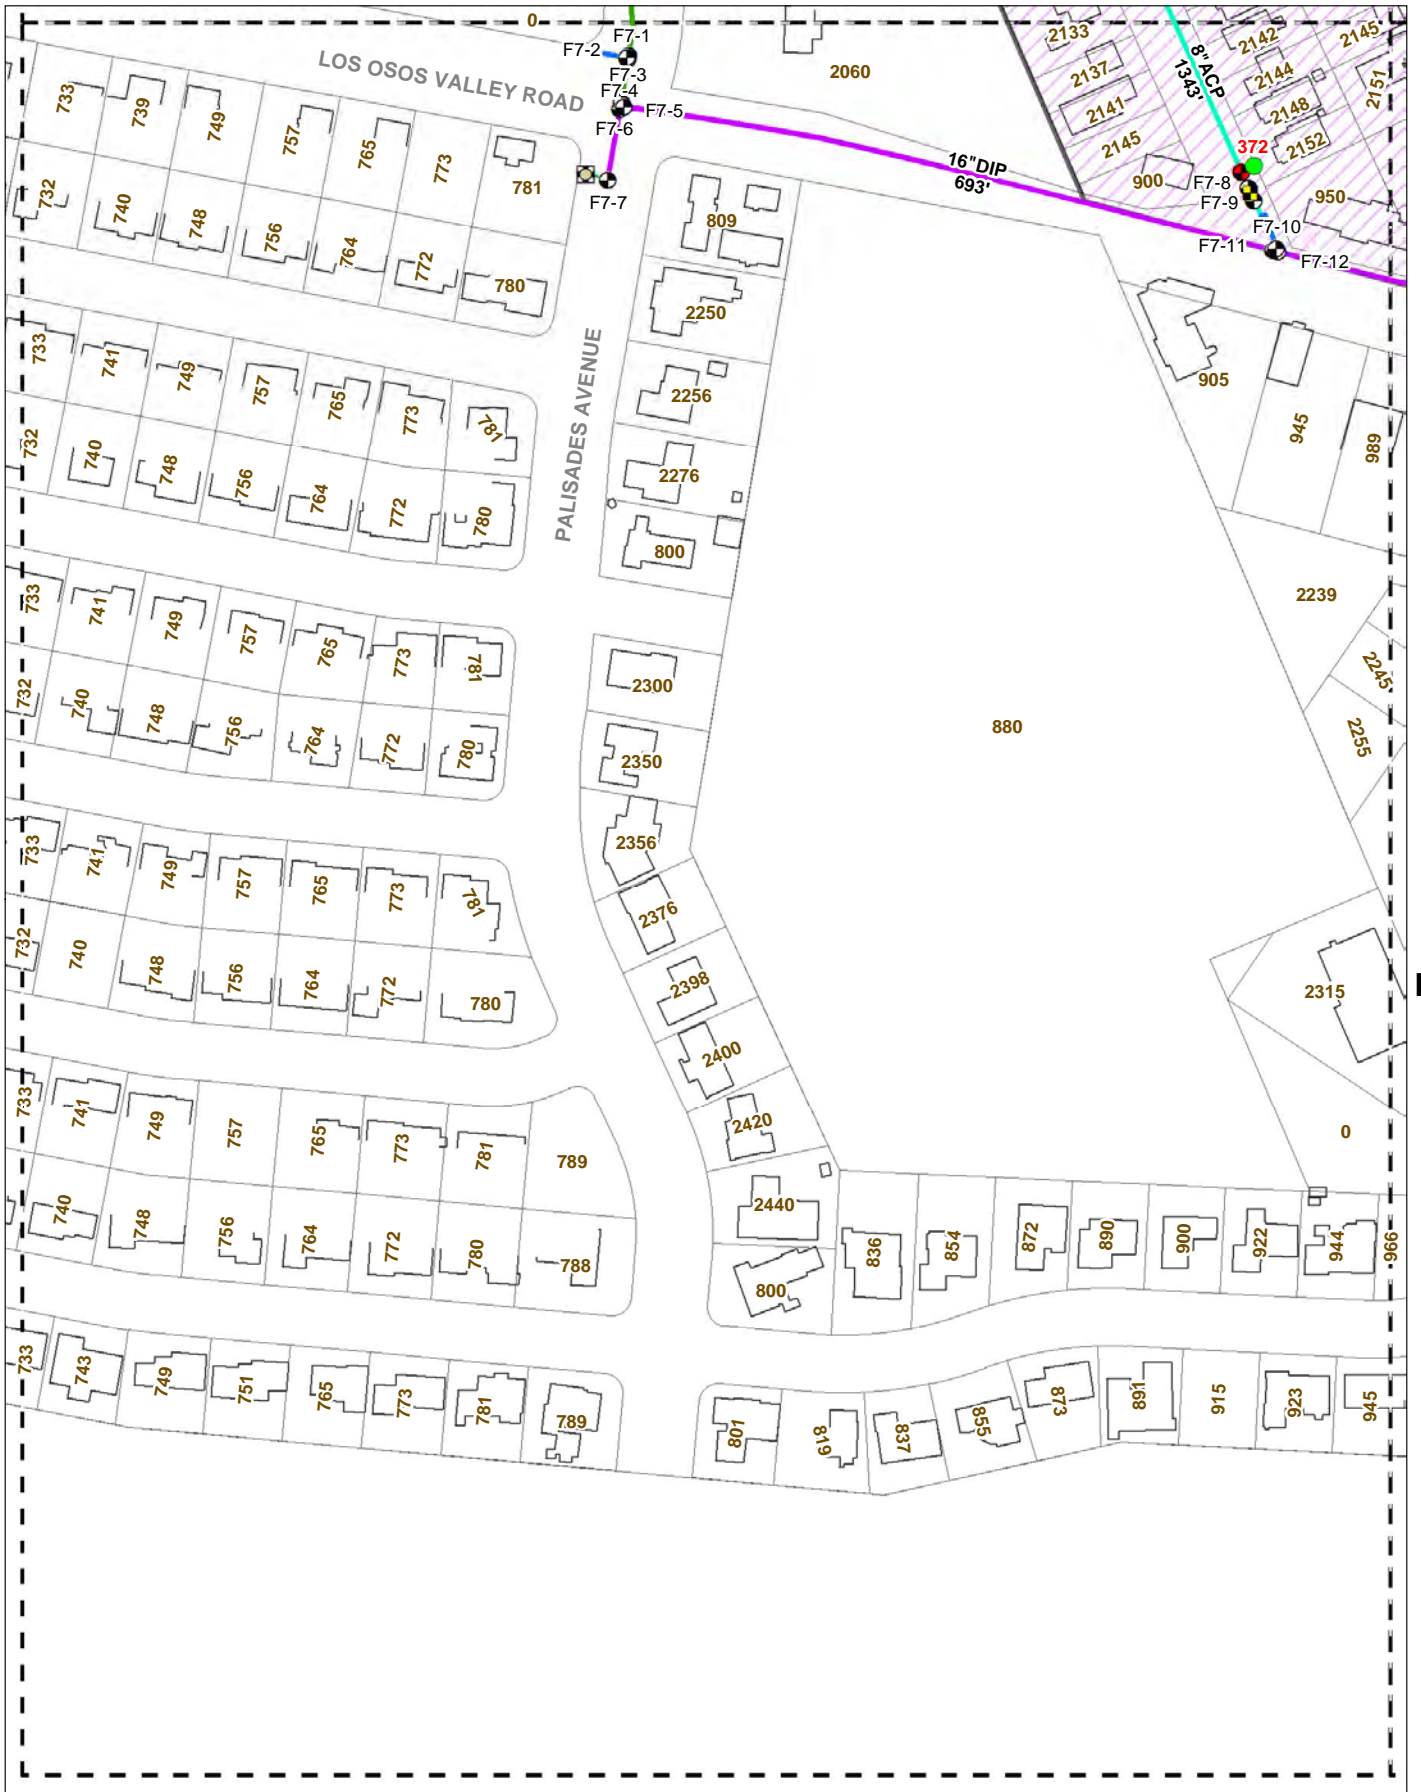



F6

F8

G7

LOS OSOS COMMUNITY SERVICES DISTRICT
WATER DISTRIBUTION SYSTEM

SHEET: F7




WALLACE GROUP
MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			

LOS OSOS COMMUNITY SERVICES DISTRICT
MAIN VALVE LISTING FOR SHEET F8

ID	SIZE	MAKE	INSPECT DATE	INSPECTED BY	TURNS	CONDITION	COMMENT
F8-1	12		11/1/2011	RF/RD/WHS	19.5	Turns Freely	
F8-2	16	Mueller	11/1/2011	RF/RD/WHS	30.7	Turns Freely	
F8-3	6	Mueller			0		Abandoned Do Not Open
F8-4	16	Mueller	11/1/2011	RF/RD/WHS	30.8	Moderately	Dead end
F8-5	6		3/2/2001	FA/RK	20	Turns Freely	Abandoned in 2008

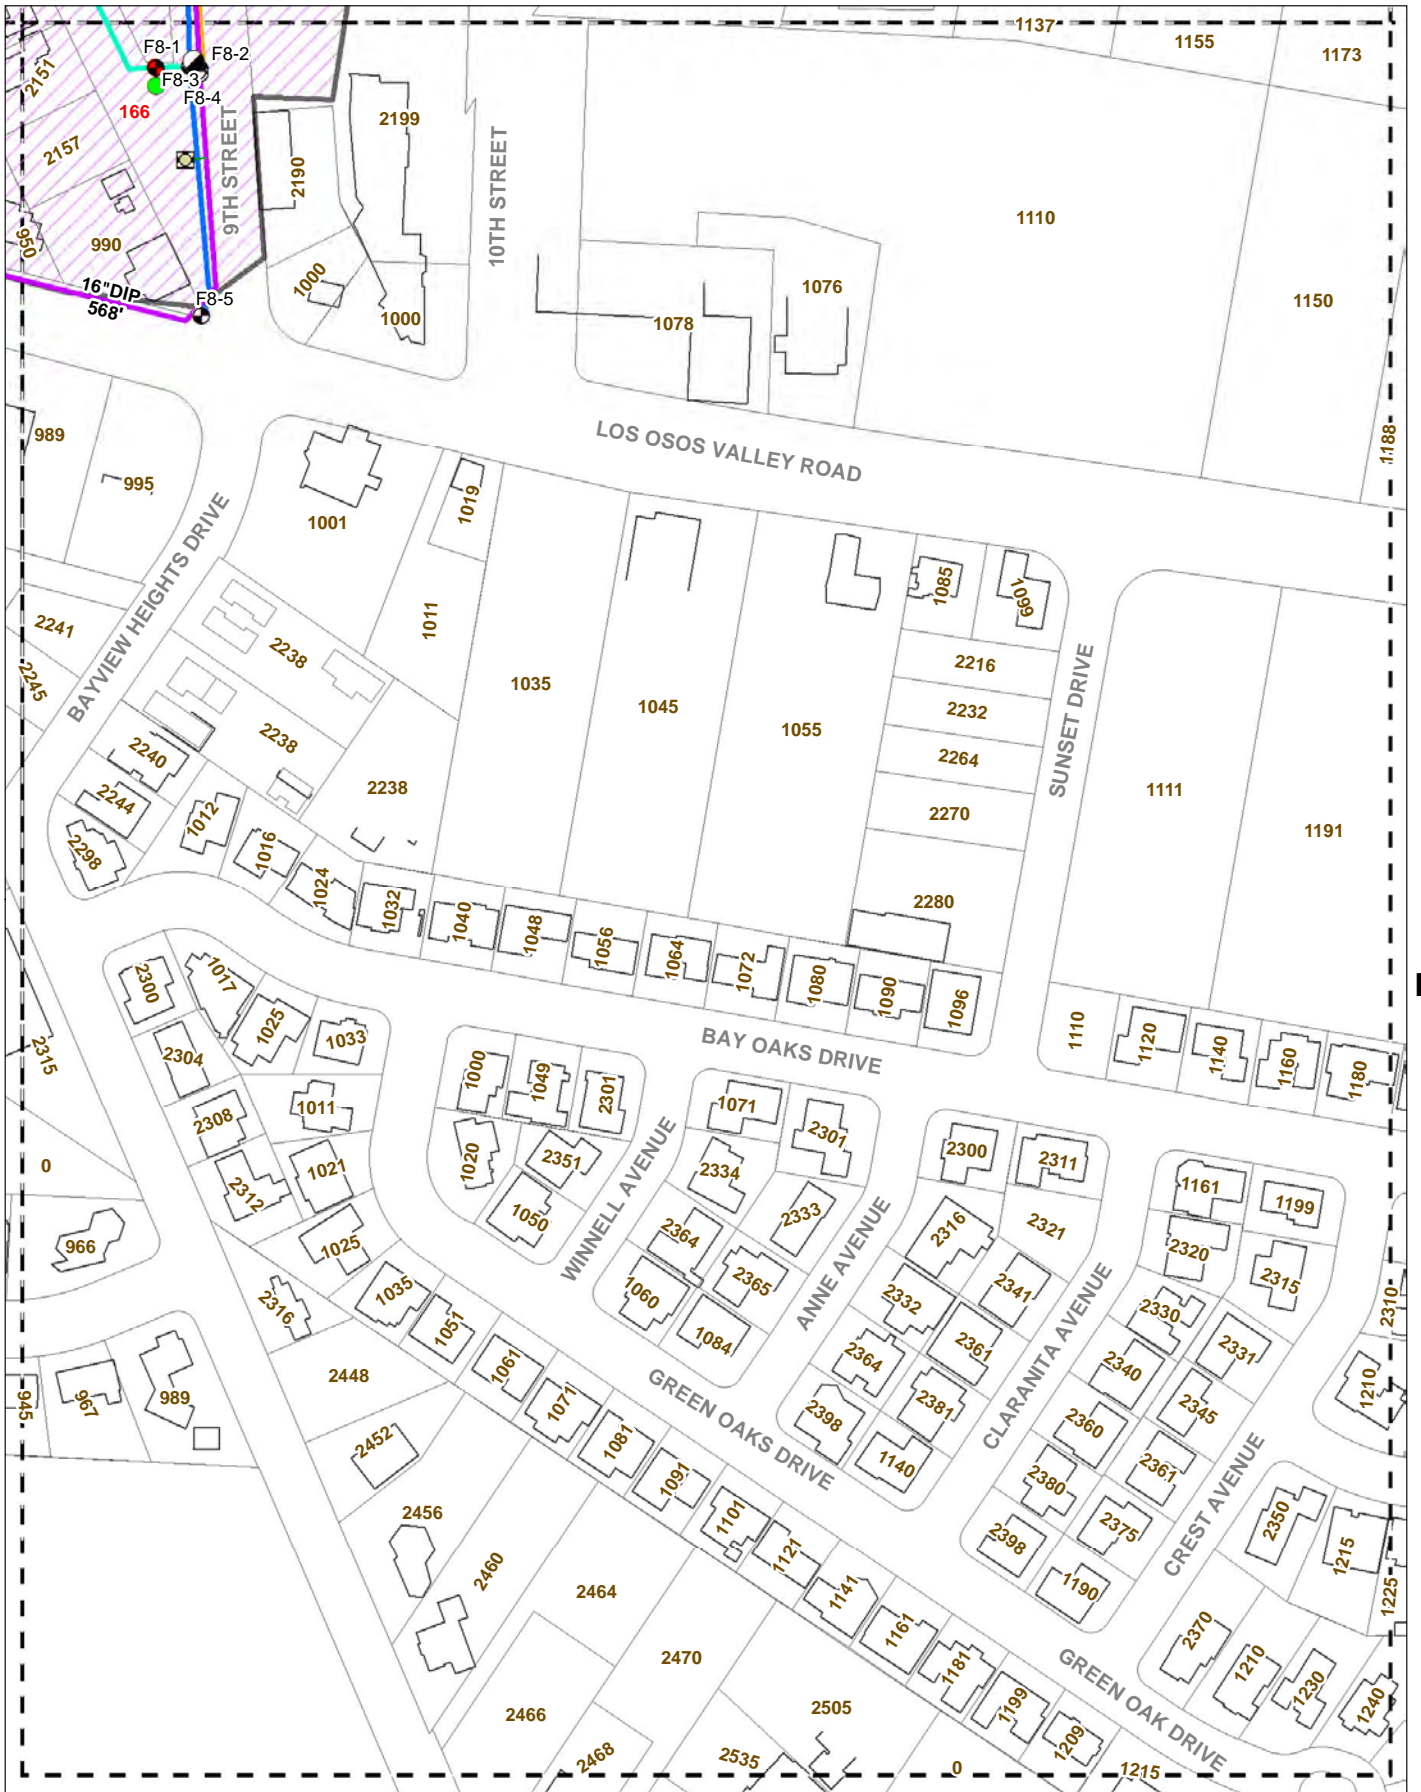



F7

F9

LOS OSOS COMMUNITY SERVICES DISTRICT
 WATER DISTRIBUTION SYSTEM



1 inch = 200 feet



WALLACE GROUP
 MAP PUBLISHED APRIL 2012

B6	B7	B8	B9	B10
C6	C7	C8	C9	C10
D7	D8	D9	D10	
E7	E8	E9	E10	
F7	F8			